iJRASET
International Journal For Research in Applied Science and Engineering Technology



INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

Volume: 14 **Issue:** I **Month of publication:** January 2026

DOI: https://doi.org/10.22214/ijraset.2026.76884

www.ijraset.com

Call: 08813907089 | E-mail ID: ijraset@gmail.com

International Journal for Research in Applied Science & Engineering Technology (IJRASET)
ISSN: 2321-9653; IC Value: 45.98; SJ Impact Factor: 7.538
Volume 14 Issue I Jan 2026- Available at www.ijraset.com

A Comprehensive Review on Performance Enhancement of Vapor Compression Refrigeration Systems Using Nanoparticle-Enhanced Refrigerants and Capillary Tube Optimization

Harendra Bind[1], Amit Shrivastava[2]
[1] *M.tech Scholar,* [2]*Assistant Prof., Department of Mechanical Engineering, Shri Ram college of Engineering & Management Banmore Gwalior, Madhya Pradesh 476444, India*

Abstract: ***Vapor Compression Refrigeration Systems (VCRS) are widely used in domestic, commercial, and industrial applications due to their reliability and compact design. However, increasing energy demand and environmental concerns associated with conventional refrigerants have driven researchers to explore advanced techniques for improving system efficiency. One promising approach involves the use of nanoparticle-enhanced refrigerants (nano-refrigerants) and optimization of expansion devices such as capillary tubes. This review paper presents a comprehensive analysis of recent research on the application of metal and metal-oxide nanoparticles, including CuO, SiO_2, Al_2O_3, ZnO, and MnO_2, dispersed in conventional refrigerants such as R134a. The influence of nanoparticle type, concentration, stability, and capillary tube diameter on system performance parameters—such as coefficient of performance (COP), heat transfer rate, compressor power consumption, and pressure characteristics—is critically reviewed. The study highlights performance improvements reported in experimental and numerical investigations and discusses the challenges related to nanoparticle dispersion, system compatibility, and long-term reliability. Future research directions for achieving sustainable and high-efficiency refrigeration systems are also outlined.***
Keywords: Vapor Compression Refrigeration System; Nano-Refrigerant; R134a; Nanoparticles; Capillary Tube; Coefficient of Performance; Heat Transfer Enhancement.

I. INTRODUCTION

Vapor Compression Refrigeration Systems (VCRS) play a vital role in food preservation, air conditioning, medical storage, and industrial cooling processes. Despite their widespread use, conventional refrigeration systems suffer from limitations such as high energy consumption and environmental impacts due to refrigerants with high global warming potential (GWP). Improving the thermal performance and energy efficiency of VCRS has therefore become a major focus of recent research.

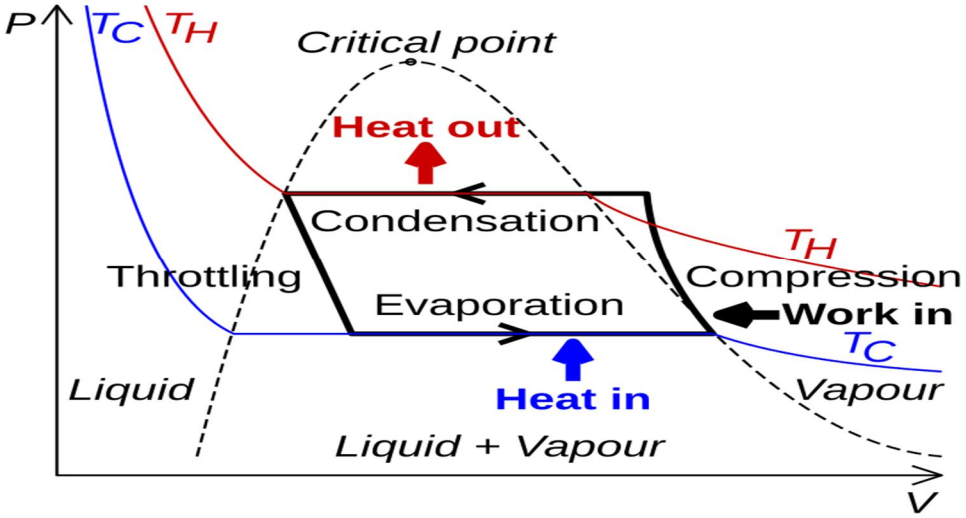


Figure 1: p-h diagram of vapour compression refrigeration cycle

©IJRASET: All Rights are Reserved

Nanotechnology has emerged as an effective solution for enhancing heat transfer characteristics in thermal systems. The dispersion of nanoparticles into base refrigerants or compressor lubricants has been shown to improve thermal conductivity, boiling heat transfer, and overall system performance. Additionally, the capillary tube, which acts as an expansion device in small-scale refrigeration systems, significantly influences refrigerant flow behavior and system efficiency. Optimizing capillary tube diameter and length in combination with nano-refrigerants offers a promising route toward performance enhancement.

II. NANOPARTICLES AND NANO-REFRIGERANTS

Nanoparticles are ultra-fine particles with sizes typically ranging from 1 to 100 nm. Due to their high surface area-to-volume ratio and unique thermophysical properties, nanoparticles can significantly enhance heat transfer when dispersed in base fluids.

Nano-refrigerants are formed by suspending nanoparticles in conventional refrigerants using suitable dispersion techniques. Commonly used nanoparticles in refrigeration research include copper oxide (CuO), aluminum oxide (Al_2O_3), silicon dioxide (SiO_2), zinc oxide (ZnO), titanium dioxide (TiO_2), and manganese dioxide (MnO_2). These nanoparticles improve thermal conductivity, reduce frictional losses, and enhance boiling and condensation heat transfer characteristics.

III. METHODS OF NANO-REFRIGERANT PREPARATION AND STABILITY

The preparation of stable nano-refrigerants is critical for reliable system performance. Common preparation methods include the two-step method, where nanoparticles are first synthesized and then dispersed into the refrigerant, and the use of surfactants or ultrasonic agitation to prevent agglomeration. Stability is a major concern in nano-refrigerants, as particle sedimentation can lead to system blockage and performance degradation. Researchers have employed techniques such as zeta potential analysis, visual sedimentation tests, and long-term performance monitoring to evaluate nano-refrigerant stability.

IV. EFFECT OF NANOPARTICLES ON VCRS PERFORMANCE

Numerous experimental studies have reported improvements in VCRS performance with the use of nano-refrigerants. The addition of nanoparticles generally results in:

1) Enhanced thermal conductivity of the refrigerant
2) Increased heat transfer coefficients in evaporators and condensers
3) Reduction in compressor power consumption
4) Improvement in coefficient of performance (COP)

Studies using CuO and Al_2O_3 nanoparticles with R134a have reported COP improvements ranging from 10% to 25% compared to pure refrigerants. Hybrid nanoparticles, such as CuO–SiO_2 or CuO–ZnO mixtures, have demonstrated even higher performance enhancements due to synergistic thermal effects.

V. INFLUENCE OF CAPILLARY TUBE DIAMETER

The capillary tube plays a crucial role in regulating refrigerant mass flow rate and pressure drop. Several studies have shown that capillary tube diameter significantly affects system performance when nano-refrigerants are used.

Smaller diameter capillary tubes generally increase pressure drop, which can enhance cooling performance up to an optimal limit. Larger diameters reduce flow resistance but may lead to insufficient expansion. Experimental investigations reveal that optimized capillary tube diameters, when combined with nano-refrigerants, result in higher COP and improved system stability.

VI. HYBRID NANOPARTICLES IN REFRIGERATION SYSTEMS

Recent research has shifted toward the use of hybrid nanoparticles to exploit the combined advantages of different materials. Hybrid nano-refrigerants such as CuO–SiO_2–MnO_2 have shown superior thermal performance compared to single nanoparticles.

These hybrid combinations enhance heat transfer rates, stabilize thermal performance, and reduce energy consumption. However, challenges related to preparation complexity, cost, and long-term stability remain areas of active investigation.

VII. CHALLENGES AND LIMITATIONS

Despite promising results, several challenges hinder the large-scale application of nano-refrigerants:

1) Agglomeration and sedimentation of nanoparticles
2) Increased viscosity leading to higher pumping power
3) Compatibility issues with compressor materials and lubricants

©IJRASET: All Rights are Reserved | SJ Impact Factor 7.538 | ISRA Journal Impact Factor 7.894 |

4) Economic feasibility and nanoparticle cost

Addressing these challenges is essential before nano-refrigerants can be widely adopted in commercial refrigeration systems.

VIII. FUTURE RESEARCH DIRECTIONS

Future studies should focus on:


1) Identifying optimal nanoparticle types and concentrations
2) Long-term reliability and durability testing
3) Development of eco-friendly and low-cost nanoparticles
4) Integration with low-GWP refrigerants
5) Numerical modeling and optimization of capillary tube geometry

IX. CONCLUSION

This review highlights the significant potential of nanoparticle-enhanced refrigerants and capillary tube optimization in improving the performance of vapor compression refrigeration systems. Experimental and numerical studies consistently demonstrate improvements in heat transfer and COP with the use of nano-refrigerants, particularly hybrid nanoparticle combinations. While challenges related to stability, cost, and system compatibility remain, continued research and technological advancements are expected to pave the way for sustainable and energy-efficient refrigeration systems in the near future.

REFERENCES

[1] S. Garimella et al. Condensation of zeotropic mixtures of low-pressure hydrocarbons and synthetic refrigerants International Journal of Heat and Mass Transfer (2020)
[2] L. Lin et al. Review of low-GWP refrigerant pool boiling heat transfer on enhanced surfaces Int J Heat Mass Transf (2019)
[3] B. Whitman Refrigeration and air conditioning technology (2012) P. Kyle Climate policy and the long-term evolution of the US buildings sector The Energy Journal (2010)
[4] C. EzgiDesign and thermodynamic analysis of waste heat-driven zeolite–water continuous-adsorption refrigeration and heat pump system for shipsEnergies(2021)
[5] S. Fan et al.A review of two-phase submerged boiling in thermal management of electronic coolingInternational Journal of Heat and Mass Transfer(2020)
[6] B. Parizad BenamReview on high heat flux flow boiling of refrigerants and water for electronics coolingInternational Journal of Heat and Mass Transfer(2021) E.A. HeathAmendment to the Montreal Protocol on Substances that Deplete the Ozone Layer (Kigali Amendment)International Legal Materials(2017)
[7] Arpagaus, C., Experimental Investigation of R1336mzz (E) in a High-temperature Heat PumpJ. Drofenik et al.Comparison of the New Refrigerant R1336mzz(E) with R1234ze(E) as an Alternative to R134a for Use in Heat PumpsProcesses(2022)
[8] M.A. Kedzierski et al.Pool Boiling of R514A, R1224 yd(Z), and R1336mzz(E) on a Reentrant Cavity SurfaceJournal of Heat Transfer(2021)
[9] Bradley D. Bock,Matteo Bucci,Josua P. Meyer Pool boiling of refrigerants over nanostructured and roughened tubesInternational Journal of Heat and Mass Transfer4 September 2020
[10] Behnam Parizad Benam,Abdolali Khalili Sadaghiani,Ali Koşar A review on experimental investigations of refrigerant/oil mixture flow boiling in horizontal channels Applied Thermal Engineering26 June 2021
[11] Wenxiao ChuGang YanQiuwang Wang A review on the performance of nanoparticles suspended with refrigerants and lubricating oils in refrigeration systems Renewable and Sustainable Energy ReviewsJanuary 2011

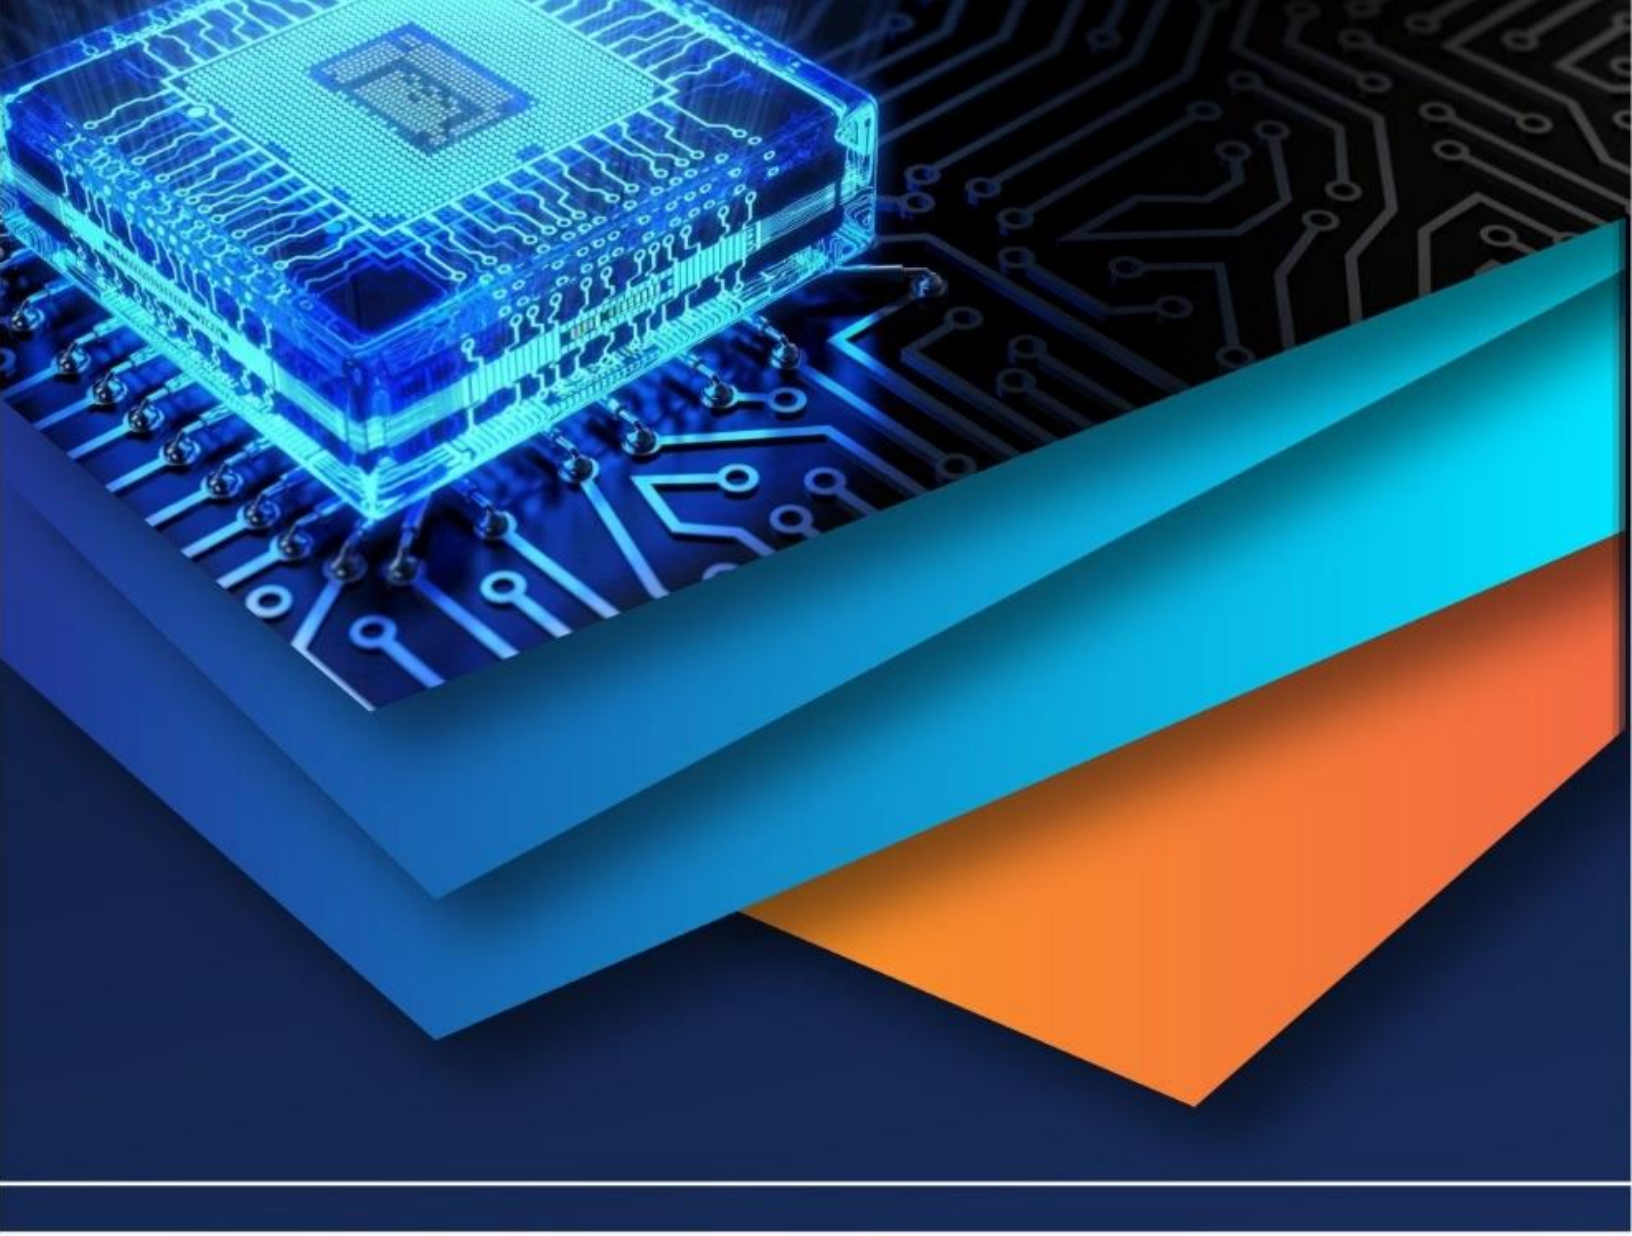

10.22214/IJRASET

45.98

IMPACT FACTOR: 7.129

IMPACT FACTOR: 7.429

INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

Call : 08813907089 (24*7 Support on Whatsapp)