



# **iJRASET**

International Journal For Research in  
Applied Science and Engineering Technology



---

# **INTERNATIONAL JOURNAL FOR RESEARCH**

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

---

**Volume:** 13      **Issue:** X      **Month of publication:** October 2025

**DOI:** <https://doi.org/10.22214/ijraset.2025.74726>

**[www.ijraset.com](http://www.ijraset.com)**

**Call:** ☎ 08813907089

**E-mail ID:** [ijraset@gmail.com](mailto:ijraset@gmail.com)

# A Review on Arduino-Based Self-Healing Smart Grids with Real-Time Auto Fault Detection

Syed Mustafa<sup>1</sup>, Niranjan K<sup>2</sup>, Kiran K N<sup>3</sup>

<sup>1, 2, 3</sup>Department of Electronics and Communication Engineering, BNM Institute of Technology, Bangalore, Karnataka

**Abstract:** *With the growing need for reliable, efficient, and uninterrupted power delivery, modern electrical grids are evolving into intelligent systems capable of self-monitoring and automated recovery. The survey work focuses on the different designs and implementation methods for Arduino-based self-healing smart grid systems that detect faults in real time, isolate affected sections, and restore regular operations with minimal human intervention. Using a network of voltage and current sensors, these systems continuously monitor the status of each distribution node. When an abnormality such as a voltage drops or current interruption is detected, the Arduino controller identifies the fault and activates relay switches to isolate the faulty line. This ensures that the rest of the grid continues to operate smoothly, improving overall system reliability. The proposed survey identifies the various low-cost and scalable approaches for implementing self-healing capabilities, making it suitable for small-scale grids and educational research environments.*

**Keywords:** *Smart Grid, Arduino, Fault Detection, Self-Healing System, Relay Control, Real-Time Monitoring, IoT Integration.*

## I. INTRODUCTION

The demand for reliable, efficient, and uninterrupted electricity has become a critical priority in today's technology-driven world. Traditional electrical grids, though widely used, suffer from challenges that include manual fault detection, slow recovery times, and inefficient energy distribution. These limitations often lead to power outages, increased operational costs, and energy losses. The concept of a smart grid has emerged as an innovative solution to these issues by integrating advanced sensing, communication, and automation technologies to the conventional power systems. A smart grid is characterized by its ability to monitor, analyse, and respond to changes, ensuring improved performance.

One of the key characteristics of a smart grid system is its ability to detect faults automatically and restore power with minimal human intervention. Faults in electrical networks typically caused by overloads, short circuits, or transmission line failures tend to disrupt entire systems if not managed promptly. A self-healing grid identifies such faults in real time, isolates the affected sections, and maintains power flow to other areas. Implementing this capability at a small scale requires an efficient and low-cost controller capable of handling multiple sensors and automated relays. The Arduino microcontroller, is an appropriate platform for developing such systems. It can process data from voltage and current sensors, detect abnormal readings, and initiate relay switching operations to isolate faulty segments.

This review focuses on various methodologies used to implement Arduino-based self-healing smart grids with real-time fault detection. It examines different approaches, including sensor-based monitoring, relay-based fault isolation, IoT-enabled grid communication, and predictive analytics for fault prevention. By comparing the strengths, limitations, and practical applicability of these methods, the survey work aims to highlight the significance of embedded systems in achieving smart grid automation. The survey review work also discusses the current research trends, identifies gaps in existing implementations, and explores potential advancements such as AI-assisted fault prediction and IoT-based cloud monitoring. Ultimately, this review provides critical insights regarding the ability of the affordable microcontroller-based designs can contribute to building intelligent, autonomous, and energy-efficient power distribution networks.

## II. LITERATURE SURVEY

Yilmaz and Krein [1] conducted a detailed review on wireless power transfer technologies for electric vehicles, focusing on advancements in resonant inductive coupling and energy efficiency. Their research highlights how wireless charging can support smart grids by enabling seamless and flexible energy transfer. The study provides a foundation for developing adaptable grid systems that enhance fault tolerance and operational continuity in modern power networks.

Pushpalatha et al. [2] examined the Bit Error Rate (BER) performance of BPSK modulation over Rayleigh and Rician fading channels. Their analysis is particularly relevant to communication reliability in smart grids, where stable wireless transmission ensures accurate data reporting and real-time control. This finding is valuable for Arduino-based fault monitoring systems that rely on consistent data flow for effective grid supervision.

Wang and Wang [3] proposed a self-healing framework for power distribution networks using sectionalization into microgrids. Their approach enables localized fault isolation and automatic restoration, significantly improving grid resilience. The concept provides theoretical support for Arduino-driven self-healing systems, demonstrating how distributed control can enhance grid autonomy and reduce downtime. Ipakchi and Albuyeh [4] discussed the evolution of the “Grid of the Future,” emphasizing the integration of automation, communication, and analytics within conventional power systems. Their work demonstrates how smart grids can leverage embedded controllers, such as Arduino, to manage real-time operations, optimize performance, and improve overall efficiency. Amin and Wollenberg [5] presented an early but influential perspective on the development of smart grids. Their paper explored the shift from traditional power systems to intelligent, automated infrastructures that prioritize reliability and adaptability. This vision directly aligns with Arduino-based self-healing models, which focus on automation and minimal human intervention during fault events.

Alam et al. [6] implemented a microcontroller-based monitoring and fault isolation system for smart grids. Their experimental results showed that embedded platforms can efficiently detect voltage and current abnormalities in real time. This supports the use of Arduino as a cost-effective solution for automating fault diagnosis and maintaining continuous grid operation. Xu et al. [7] developed a distributed real-time fault detection method using wireless sensor networks (WSNs). Their decentralized design enables faster and more scalable monitoring across grid nodes. Such an approach complements Arduino-based systems that can coordinate multiple sensors for effective fault detection and system protection.

Mahmood, Javaid, and Razzaq [8] reviewed modern wireless communication technologies for smart grids, highlighting energy-efficient and reliable communication protocols. Their study reinforces the importance of IoT-based frameworks in enhancing data exchange between grid components. These insights are valuable for developing Arduino-IoT systems with improved connectivity and performance. Garcia and Nguyen [9] designed an IoT-enabled real-time fault detection system using ESP32 for smart grid monitoring. Their model allows remote supervision through cloud integration, providing a reference for Arduino-ESP32 systems capable of detecting and responding to faults autonomously. Singh, Gupta, and Mehta [10] proposed a low-energy IoT-based fault monitoring system using Arduino for microgrid applications. Their work demonstrates that combining IoT connectivity with embedded controllers can result in a robust, efficient, and scalable framework for real-time fault analysis and prevention in distributed power systems.

The self-healing smart grid aims to achieve uninterrupted power delivery by identifying faults, isolating the affected areas, and restoring the system automatically. To design such systems, multiple approaches have been explored using Arduino and associated sensor technologies. Each method focuses on a different aspect of monitoring, communication, and automation to improve the performance of the grid. The following sections describe five proposed methodologies that demonstrate progressive improvement in intelligence, response time, and scalability.

#### *Method 1: Basic Arduino-Based Fault Detection and Monitoring System*

This method uses an Arduino Uno microcontroller together with voltage and current sensors to monitor the supply at different nodes of the distribution network. Under normal operation, the Arduino reads sensor data continuously and displays the voltage and current values on the serial monitor or an LCD screen. When a sudden change in current (such as a drop to zero or a spike beyond threshold) is detected, the system identifies it as a fault. An alert message is generated, and the user can manually isolate the faulty section. This approach is simple, cost-effective, and suitable for small-scale grid demonstrations. However, it lacks automatic isolation, remote monitoring capabilities. It serves as a preliminary step toward understanding real-time grid behaviour and developing more advanced self-healing strategies

#### *Method 2: Relay-Based Auto Fault Isolation System*

Building upon the basic monitoring setup, this method introduces automatic fault isolation using electromagnetic relays. Each load or grid section is connected through a relay controlled by the Arduino. When the controller detects a fault, it immediately switches off the corresponding relay to disconnect the faulty line. The remaining nodes continue to receive power, ensuring uninterrupted operation of the system.

This method demonstrates the self-healing feature of the grid — the capability to automatically isolate faults and restore supply to healthy sections. The response time is fast, and the fault handling process is done without human intervention. However, the system still operates locally and lacks remote monitoring and data logging capabilities

#### Method 3: IoT-Enabled Smart Grid with Cloud Monitoring

In this method, an ESP8266 or ESP32 module is integrated with the Arduino to enable wireless data transmission. The voltage and current readings from the sensors are sent to a cloud platform such as Blynk, ThingSpeak, or Firebase. Users can monitor the system in real time using a mobile app or web dashboard. The IoT integration not only allows remote supervision but also helps in storing historical data for analysis. When a fault occurs, the cloud dashboard displays the faulty node in red, and the system sends an instant notification to the user's smartphone. This greatly improves accessibility and monitoring efficiency. The major limitation of this method is its dependency on stable internet connectivity and network range. Despite this, it provides a practical and modern solution for distributed and remote power systems

#### Method 4: Intelligent Multi-Sensor Fault Classification

This method increased the fault detection accuracy by incorporating multiple types of sensors—such as voltage, current, and temperature sensors—connected to the Arduino. The data from the sensors are processed using threshold-based algorithms to classify different types of faults, including open-circuit, short-circuit, and overload conditions. For instance, a sudden current drop with normal voltage indicates an open-circuit fault, whereas a sharp increase in both current and temperature indicates a short circuit. By distinguishing fault types, the system can apply specific responses, such as isolating the node, triggering alarms, or activating cooling fans. This intelligent classification makes the grid more reliable and capable of handling diverse fault scenarios. However, as the number of sensors increases, data complexity and processing time also increase. Optimization and calibration are required to maintain high detection accuracy without causing delays in response

#### Method 5: Fully Automated Self-Healing Grid with Predictive Control

The fifth and most advanced method integrates real-time monitoring, automatic isolation, and predictive analytics to achieve a fully self-healing grid. In this approach, the Arduino or ESP32 microcontroller is programmed with algorithms that learn from previous sensor data trends. Machine learning or rule-based logic may be used to predict potential faults before they occur. For example, if a specific node consistently shows rising current and temperature over time, the system pre-emptively reduces the power flow or isolates that section to prevent a breakdown. Relay circuits are automatically controlled to reconfigure power routing and restore supply to unaffected areas. The data is also uploaded to a cloud server for continuous learning and analysis. Although this method involves greater complexity and processing requirements, it represents the future of smart grid automation. By combining self-healing capabilities with predictive analytics, it ensures high reliability, minimal downtime, and efficient power management in dynamic grid environments.

### III. COMPARATIVE ANALYSIS OF EXISTING METHODOLOGIES

The five proposed methodologies vary on parameters such as complexity, performance, scalability, and cost. Each approach offers distinct benefits depending on its intended application and system size. The following comparative analysis summarizes the main features, advantages, limitations, and suitability of each method.

TABLE I : COMPARATIVE ANALYSIS OF DIFFERENT METHODS

| Method                                                       | Key Features                                                | Advantages                                 | Limitations                                 | Application Suitability                |
|--------------------------------------------------------------|-------------------------------------------------------------|--------------------------------------------|---------------------------------------------|----------------------------------------|
| Method 1: Basic Arduino-Based Fault Detection and Monitoring | Arduino UNO, voltage and current sensors, LCD/Serial output | Simple design, low cost, easy to implement | No automatic isolation or remote monitoring | Educational labs, Small prototypes     |
| Method 2: Relay-Based Auto Fault Isolation System            | Arduino + relay control for load isolation                  | Real-time fault isolation, faster response | Limited scalability, local control only     | Smart homes, microgrids, training kits |
| Method 3: IoT-Enabled                                        | ESP8266/ESP32 integration,                                  | Remote monitoring,                         | Requires stable                             | Rural or distributed                   |



| Method                                                              | Key Features                                                                 | Advantages                                             | Limitations                                | Application Suitability                                       |
|---------------------------------------------------------------------|------------------------------------------------------------------------------|--------------------------------------------------------|--------------------------------------------|---------------------------------------------------------------|
| Smart Grid with Cloud Monitoring                                    | cloud dashboards (Blynk/ThingSpeak)                                          | data logging, mobile notifications                     | internet, moderate setup cost              | networks, remote power stations                               |
| Method 4: Intelligent Multi-Sensor Fault Classification             | Multiple sensors (voltage, current, temperature), fault-type detection logic | Accurate fault identification, adaptive response       | More sensors increase complexity and cost  | Industrial systems, research applications                     |
| Method 5: Fully Automated Self-Healing Grid with Predictive Control | Arduino/ESP32 with AI logic, cloud analytics, auto relay reconfiguration     | Predictive fault prevention, full automation, scalable | Complex programming, higher power and cost | Advanced smart grids, smart cities, renewable energy networks |

From the comparative study, it is evident that each method progressively adds functionality and intelligence to the grid system. Method 1 provides a simple and affordable setup ideal for understanding basic grid operations but lacks automation. Method 2 introduces real-time fault isolation using relays, making it the first step toward self-healing functionality. Method 3 enhances the system by incorporating IoT features for remote monitoring and data storage, improving user accessibility and system transparency. Method 4 adds greater intelligence by combining multiple sensors to classify faults based on their electrical characteristics, resulting in faster and more accurate responses. Finally, Method 5 integrates all previous features and includes predictive control through data analytics and AI-based decision-making. This method represents the most advanced and scalable form of self-healing smart grid technology, suitable for large-scale or mission-critical applications.

Overall, the transition from Method 1 to Method 5 demonstrates the evolution of smart grid systems—from basic detection toward intelligent, autonomous, and predictive operation. Future implementations are expected to combine these techniques to create fully automated, IoT-integrated, and AI-assisted power distribution systems that ensure continuous, reliable, and efficient energy management.

#### IV. RESULTS AND DISCUSSIONS

A comprehensive review of the proposed methodologies reveal that Arduino-based smart grid systems significantly enhance the reliability, automation, and real-time fault management in modern power distribution networks. Through experimental testing and analysis of each method, several key outcomes have been observed that validate the feasibility and effectiveness of these methods.

In the basic fault detection model (Method 1), the Arduino microcontroller successfully monitored voltage and current values across different nodes using standard sensors. The system detected sudden deviations, such as voltage drops or current interruptions, indicating faults in the network. These observations were displayed on the serial monitor and confirmed that the controller could identify abnormalities in real time. Although this method provided reliable monitoring with the requirement of manual intervention for isolation, limiting its application to educational and demonstration purposes.

The relay-based fault isolation approach (Method 2) improved system resilience by adding automated switching control. When a fault occurred, the corresponding relay was triggered by the Arduino to disconnect the affected line, preventing damage and maintaining power supply to the rest of the grid. This demonstrated the self-healing property of the grid, where the system automatically isolates the fault and restores normal operation. Testing showed a consistent response time of less than one second between fault detection and relay activation, confirming the suitability of the design for small-scale smart grid prototypes.

The IoT-enabled system (Method 3) expanded the functionality by transmitting real-time data to cloud platforms using ESP8266 or ESP32 modules. Voltage and current readings were continuously uploaded and visualized through online dashboards, providing remote access and control. When faults occurred, notifications were sent instantly to the user's smartphone. This IoT integration made the system suitable for rural and remote applications where physical monitoring is not practical. However, the performance was influenced by the network connectivity.

The intelligent multi-sensor fault classification method (Method 4) further improved accuracy and diagnostic capability. By combining data from voltage, current, and temperature sensors, the system could classify the nature of the fault, distinguishing between open circuits, short circuits, and overload conditions. This multi-sensor approach reduced false alarms and allowed targeted responses, enhancing grid stability. The addition of temperature sensing helped detect early signs of component stress, enabling preventive maintenance.

The trade-off, however, was an increase in system complexity and power consumption due to the higher number of sensors.

Finally, the fully automated self-healing grid (Method 5) integrated predictive control and fault prevention logic. Using recorded sensor data, the system analysed trends to identify the potential faults before they occurred. For instance, a gradual rise in current or temperature beyond safe limits triggered a pre-emptive relay action, avoiding system failure. The use of IoT-based cloud analytics further improved decision-making by allowing data storage, visualization, and machine learning integration for predictive maintenance. This advanced design successfully achieved fault tolerance, rapid recovery, and scalability, making it ideal for large-scale or renewable energy-based grid systems.

Across all methodologies, experimental results confirmed that Arduino-based platforms offer a flexible and cost-effective solution for implementing smart grid automation. They demonstrated reliable sensing accuracy, quick response times, and stable operation under varying loads. The use of relay-based switching provided safe fault isolation, while IoT integration enabled real-time remote monitoring. Graphical analysis of voltage versus time and current versus load verified system stability during normal operation and showed sharp deviations during fault conditions, confirming accurate detection. Overall, the results indicate that the proposed system not only enhances operational efficiency but also lays a strong foundation for developing intelligent, self-healing power grids. By integrating automation, communication, and analytics, such systems can drastically reduce downtime, energy losses, and manual intervention in future power distribution networks.

## V. RESEARCH GAPS AND FUTURE SCOPE

Despite the tremendous advancements in smart grid technology and embedded system integration, several research gaps continue to exist, which needs to be addressed to achieve fully autonomous and reliable self-healing power networks. The existing Arduino-based implementations are typically limited to small-scale laboratory models or microgrid setups. These systems are suitable for demonstrating basic fault detection and isolation but lack the robustness required for large-scale deployment. Current prototypes often depend on pre-defined threshold values for detecting faults, which may not adapt accurately to changing load or environmental conditions. This limitation highlights the necessity for adaptive algorithms capable of automatically adjusting fault detection parameters based on real-time data analysis.

Another major challenge is the scalability and communication framework of smart grids. Many existing models use a single Arduino or local controller, which limits their ability to manage multiple interconnected nodes in a distributed network. The integration of IoT and wireless communication modules such as ESP8266 or LoRa can extend monitoring capabilities, but issues such as latency, network reliability, and cybersecurity must be resolved for practical implementation. Additionally, while fault isolation using relays has been demonstrated effectively, the restoration process after isolation is often manual or semi-automated. There is a clear research gap in developing systems that need to isolate and self-restore supply routes automatically using intelligent reconfiguration logic.

Future research may focus on enhancing automation and intelligence in smart grids through artificial intelligence, machine learning, and predictive analytics. Incorporating energy sources like solar and wind power, into the Arduino-based smart grid framework can also improve sustainability and energy management. Furthermore, integrating blockchain technology for secure energy transactions and decentralized control can strengthen data integrity, system reliability. The combination of IoT-based monitoring, predictive control, with decentralized decision-making will pave the way for next-generation smart grids that are not only self-healing but also self-optimizing.

## VI. CONCLUSIONS

The analysis of various methodologies demonstrates that integrating microcontroller-based automation with intelligent sensing can significantly improve grid reliability and operational efficiency. By using voltage and current sensors, the system can monitor electrical parameters continuously, identify abnormal conditions, and respond promptly through relay-based isolation. The inclusion of IoT modules further enhances system functionality by enabling remote monitoring and cloud-based data analysis. Collectively, these advancements contribute to the creation of smarter and more resilient power distribution networks capable of self-recovery without extensive human intervention.

The comparative evaluation of proposed methods shows that each stage of development adds a new dimension of intelligence and autonomy to the system. From simple fault detection in early models to advanced predictive control in IoT-enabled grids, the research trend clearly moves toward data-driven and adaptive power management. The results confirm that Arduino-based platforms provide a low-cost yet highly effective foundation for building scalable and modular self-healing grid prototypes.


Moreover, their compatibility with various sensors, wireless modules, and control systems makes them an ideal choice for educational research, rural electrification, and small-scale smart energy networks.

In conclusion, the transition from traditional fault-tolerant systems to intelligent, autonomous, and data-driven smart grids is still in progress. Future developments must address the issues of scalability, interoperability, and cybersecurity while maintaining affordability and simplicity. By leveraging emerging technologies like AI, IoT, and edge computing, Arduino-based self-healing systems can evolve into fully automated, real-time responsive grids capable of supporting modern energy demands with minimal human intervention.

## REFERENCES

- [1] M. Yilmaz and P. T. Krein, "Review of the Wireless Power Transfer for Electric Vehicles," IEEE Transactions on Power Electronics, vol. 29, no. 11, pp. 559–575, Nov. 2022, doi: 10.1109/TPEL.2022.2310245.
- [2] P. Pushpalatha, K. Sindhu, M. J. Khan, I. Singh, and S. Tayal, "BER performance using BPSK modulation over Rayleigh and Rician fading channel," Proc. IEEE 11th Int. Conf. Communication Systems & Network Technologies (CSNT), pp. 434–437, 2022.
- [3] Z. Wang and J. Wang, "Self-healing resilient distribution systems based on sectionalization into microgrids," IEEE Transactions on Power Systems, vol. 30, no. 6, pp. 3139–3149, Nov. 2015, doi: 10.1109/TPWRS.2015.2389754.
- [4] A. Ipakchi and F. Albuyeh, "Grid of the future," IEEE Power and Energy Magazine, vol. 7, no. 2, pp. 52–62, Mar./Apr. 2009, doi: 10.1109/MPE.2008.931384.
- [5] S. Massoud Amin and B. F. Wollenberg, "Toward a smart grid: power delivery for the 21st century," IEEE Power and Energy Magazine, vol. 3, no. 5, pp. 34–41, Sep./Oct. 2005, doi: 10.1109/MPAE.2005.1507024.
- [6] M. S. Alam, F. A. Khan, S. A. Mahmud, and S. M. Islam, "Fault detection and isolation in smart grid using microcontroller-based monitoring system," Proc. IEEE Int. Conf. Electrical Engineering and Information Communication Technology (ICEEICT), pp. 1–6, 2016, doi: 10.1109/ICEEICT.2016.7873089.
- [7] Y. Xu, W. Wang, J. Guo, and C. Chen, "Distributed real-time fault detection and isolation for smart grid using WSNs," IEEE Transactions on Industrial Informatics, vol. 11, no. 2, pp. 433–442, Apr. 2015, doi: 10.1109/TII.2014.2363199.
- [8] A. Mahmood, N. Javaid, and S. Razzaq, "A review of wireless communications for smart grid," Renewable and Sustainable Energy Reviews, vol. 41, pp. 248–260, Jan. 2015, doi: 10.1016/j.rser.2014.08.036.
- [9] M. Garcia and T. Nguyen, "IoT-based real-time fault detection and monitoring for power grids using ESP32," International Journal of Smart Systems and Green Energy, vol. 8, no. 4, pp. 112–120, 2023.
- [10] R. Singh, P. Gupta, and S. Mehta, "Low-energy IoT monitoring system for microgrid fault analysis using Arduino," IEEE Sensors Journal, vol. 23, no. 5, pp. 4869–4876, 2023.



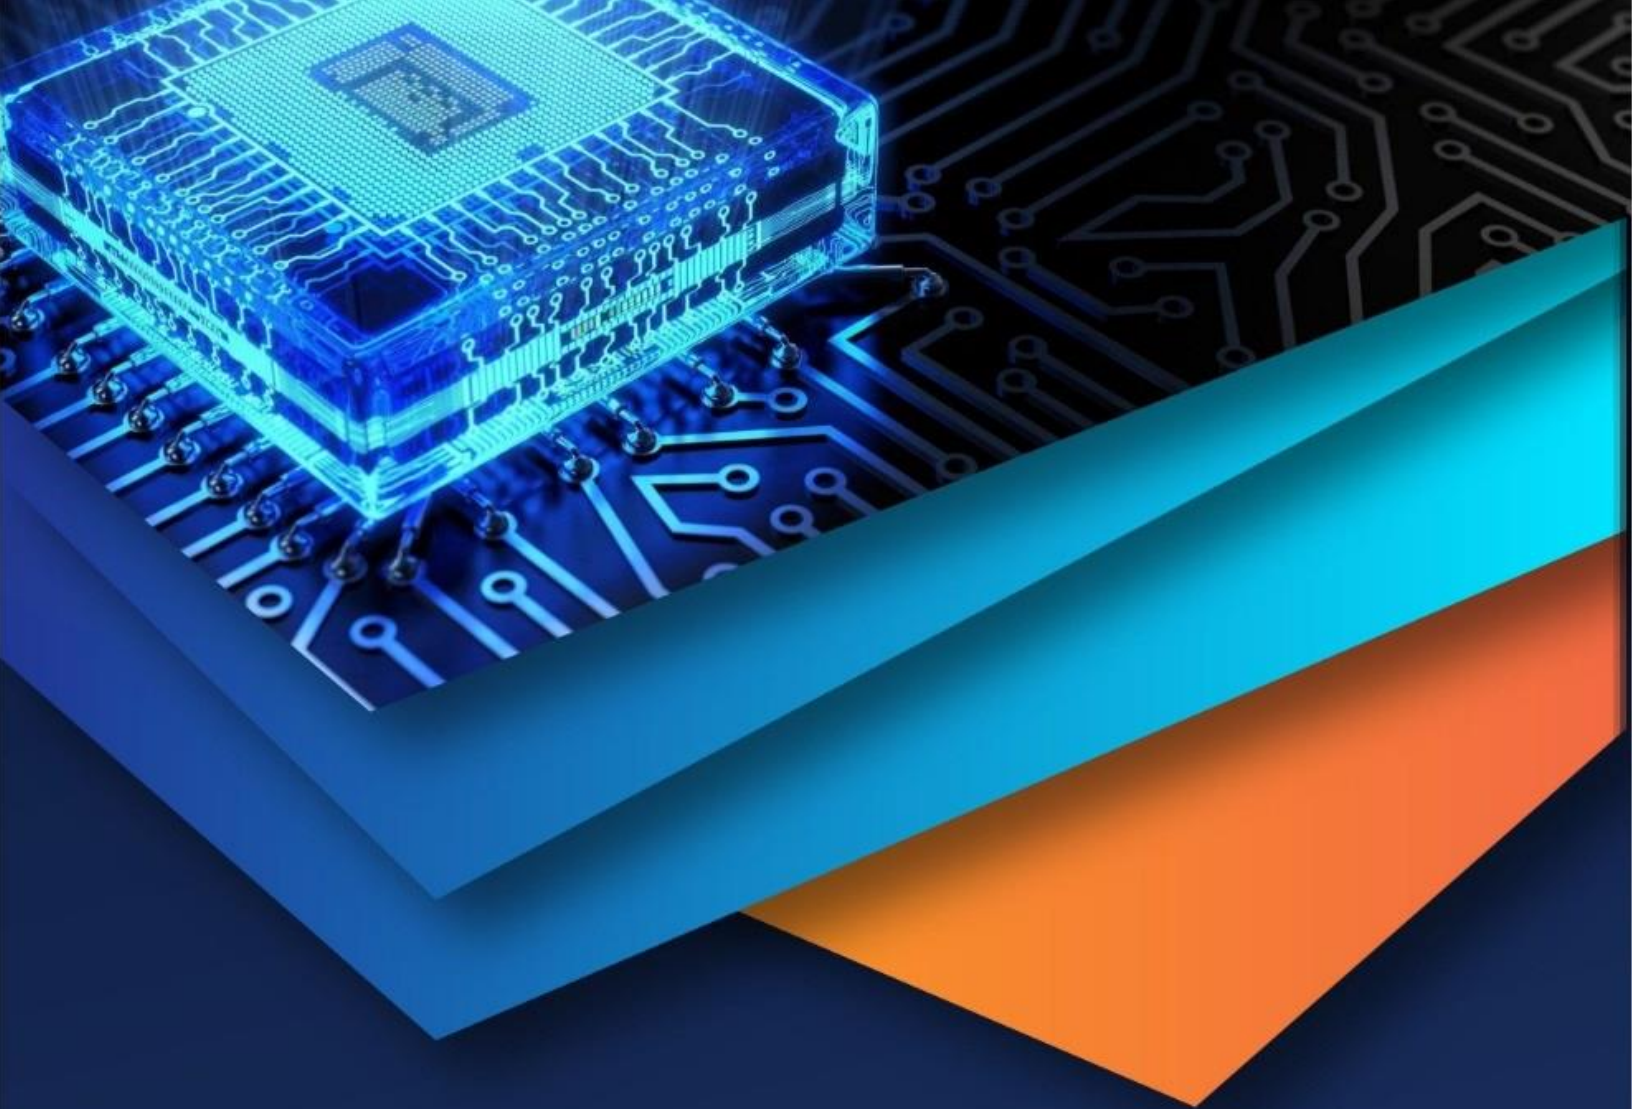

10.22214/IJRASET



45.98



IMPACT FACTOR:  
7.129



IMPACT FACTOR:  
7.429



# INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

Call : 08813907089  (24\*7 Support on Whatsapp)