iJRASET
International Journal For Research in Applied Science and Engineering Technology



# INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

**Volume:** 13 **Issue:** IX **Month of publication:** September 2025

**DOI:** https://doi.org/10.22214/ijraset.2025.74003

www.ijraset.com

Call: 08813907089 | E-mail ID: ijraset@gmail.com

International Journal for Research in Applied Science & Engineering Technology (IJRASET)
*ISSN: 2321-9653; IC Value: 45.98; SJ Impact Factor: 7.538*
*Volume 13 Issue IX Sep 2025- Available at www.ijraset.com*

# Energy Audit of Engineering Ladies Hostel

Prof. Madhvaraja K[1], Bhavani K[2], Gayathri CS[3], Mehak Zabeen[4], R Uma[5]
[1]*Assistant Professor Department of Electrical and Electronics Engineering, Proudhadevaraya Institute of Technology(PDIT), Hosapete, Karnataka, India*
[2, 3, 4, 5]*Department of Electrical and Electronics Engineering Proudhadevaraya Institute of Technology (PDIT), Hosapete, Karnataka, India*

***Abstract:*** ***This paper presents a energy audit of the Ladies Hostel at Proudadevaraya Institute of Technology (PDIT), focusing on energy consumption patterns and opportunities for improving efficiency and sustainability. The audit evaluates major energy-consuming systems, including lighting, heating, ventilation, air conditioning (HVAC), and electrical appliances, based on data collected through site inspections, utility bill analysis. Findings reveal high energy usage due to outdated lighting and inefficient appliances; transitioning to LED fixtures and optimizing natural lighting can yield substantial savings. The HVAC systems, identified as significant energy loads, are recommended for replacement with energy-efficient models and routine maintenance. Common-use appliances such as refrigerators and microwaves are outdated, prompting appliance for upgrades and energy-conscious behavior initiatives among residents. Overall, the proposed measures offer both economic and environmental benefits, aligning with broader sustainability goals, and conclude with practical recommendations for operational upgrades and awareness initiatives to foster long-term energy conservation in campus.***
***Keywords: Energy audit, Campus sustainability, HVAC systems, LED retrofitting.***

## I. INTRODUCTION

Energy audits are systematic evaluations of energy consumption patterns conducted within facilities, buildings, or organizations to identify opportunities for conservation, efficiency improvements, and cost savings. By analyzing how energy is used and where it is potentially wasted, these audits help optimize performance and reduce environmental impact.

In the context of campus housing, hostels represent a significant portion of institutional energy use due to the continuous operation of lighting, HVAC systems, and electrical appliances. This study focuses on the Ladies Hostel of Proudadevaraya Institute of Technology (PDIT), aiming to assess current consumption patterns, identify inefficiencies, and propose actionable measures for improved sustainability.

The audit evaluates outdated lighting infrastructure, energy-intensive appliances, and usage behaviors among residents. It emphasizes upgrades such as LED retrofitting, BLDC fan installations, solar water heating, and the integration of renewable energy through solar photovoltaic panels. The findings are grounded in site inspections, data analysis, and stakeholder interviews, offering both short-term savings and long-term operational benefits.

This work contributes to institutional sustainability by fostering environmental stewardship and offering practical guidelines that can be replicated across similar residential facilities.

## II. LITERATURE REVIEW

Energy audits in hostel buildings reveal high energy consumption from lighting, cooking systems, and electronic devices. Studies across educational institutions emphasize the impact of structured audits— ranging from basic walk-throughs to detailed metering analyses—with recommendations like LED retrofits, steam cooking solutions, and building envelope improvements. Sameeullah [1] and Madhusudan et al. [2] demonstrate how targeted audits can uncover hidden inefficiencies and provide realistic savings with clear payback periods.

Lonare et al. [3] and Li [4] explore the value of resident engagement, daylight usage, and thermal comfort adjustments to lower consumption sustainably. Despite hurdles such as budget constraints, lack of awareness, and limited technical expertise, emerging technologies like IoT-based monitoring systems [5] and BEE policy frameworks pave the way for real-time energy tracking and strategic implementation. These audits not only reduce costs but also foster a culture of environmental responsibility among hostel residents.

©IJRASET: All Rights are Reserved 

*ISSN: 2321-9653; IC Value: 45.98; SJ Impact Factor: 7.538*
*Volume 13 Issue IX Sep 2025- Available at www.ijraset.com*

## III. METHODOLOGY AND DATA COLLECTION

The energy audit at PDIT Ladies Hostel was conducted through a structured multi-phase approach comprising pre-audit preparation, site-level data collection, analytical assessment, recommendation planning, and reporting.



Figure.1.PDIT Ladies hostel

### *A. Pre-Audit Phase*

The audit scope was defined to include lighting systems, HVAC units, kitchen equipment, and general electrical loads. Initial data such as monthly energy bills, room occupancy levels, and historical consumption trends were collected. Audit planning encompassed resource allocation, timeline scheduling, and stakeholder engagement.



Figure.2. Transformer

### *B. Site Inspection and Data Collection*

A comprehensive walk-through of the facility was performed, covering 55 rooms and shared spaces such as kitchen and mess hall. Real-time measurements were recorded using data loggers and meter readings. Visual inspection was complemented by staff interviews to identify usage behaviors. An inventory of energy- consuming appliances—including fans, fluorescent tubes, LED lights, refrigerators, pumps, and sockets— was compiled.



Figure .3. PDIT Ladies hostel Floors

©IJRASET: All Rights are Reserved 

*ISSN: 2321-9653; IC Value: 45.98; SJ Impact Factor: 7.538*
*Volume 13 Issue IX Sep 2025- Available at www.ijraset.com*

### *C. Data Analysis*

Energy usage data were analyzed to identify daily and annual consumption patterns. Benchmarking with similar institutions was performed to gauge efficiency gaps. Equipment with excessive energy loads, such as 75 W fans and 36 W tube lights, were flagged for replacement.



Figure.4.PDIT Hostel Water Pump



Figure.5.PDIT Hostel DG Set

### *D. Recommendation Development*

Based on load profiling, recommendations included replacing AC induction fans with BLDC fans, tube lights with LED T-bulbs, and conventional appliances with energy-efficient models. Cost-benefit analysis revealed estimated savings of ₹5469/month.

### *E. Implementation Plan*

An implementation roadmap was designed, including equipment procurement, stakeholder coordination, and installation sequencing. Considerations were made for future solar integration via rooftop PV systems.

## IV. ENERGY CONSUMPTION ANALYSIS

The case study considered here is an engineering college boarding for ladies. Totally there are 55 rooms available for accommodation. In addition to this we have kitchen, and mess hall. These rooms have a total of 62 fans, 77 fluorescent lights, 40 zero watts bulb, 1refrigerator, 1 Grinder, 9 power sockets, 2 water pumps, 2 exhaust fans, 65 LED lights, 61sockets, 2 water purifier with cooler.

©IJRASET: All Rights are Reserved | SJ Impact Factor 7.538 | ISRA Journal Impact Factor 7.894 |



Figure.6.Electrical Control Panel

Table.1.Energy Consumption In Hostel Rooms

| Electric load | Quantity | wattage (W) | Daily hours of usage | Kwh used in a day | Kwh used in a year |
|---|---|---|---|---|---|
| Fan | 55 | 75W | 10h | 41.25 | 12,375 |
| Tube light | 75 | 36W | 8h | 21.62 | 6480 |
| LED light | 57 | 22W | 4h | 10.032 | 3009.6 |
| Sockets | 55 | 65W | 3h | 14.3 | 4890 |
| Water pump | 1 | 5HP | 2h | 7.46 | 2238 |
| Water pump | 1 | 1HP | 2h | 1.49 | 447.6 |
| Zero bulbs | 40 | 12W | 7h | 3.36 | 1530 |
| Power sockets | 9 | 1500W | 2h | 27 | 4860 |

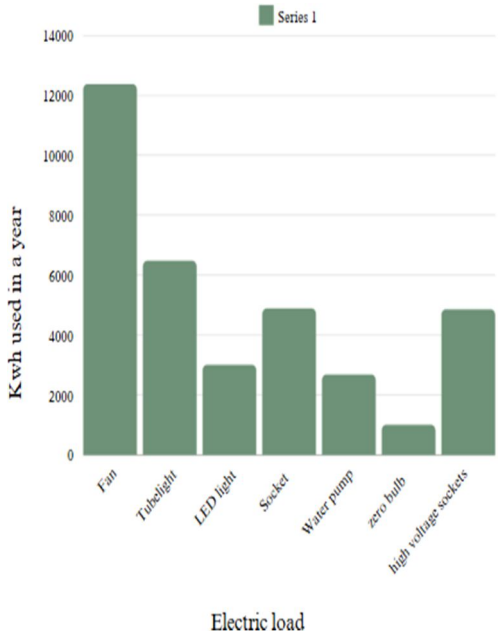



Figure.7. Energy Consumption In Hostel Rooms

The energy distribution in the over all hostel rooms is observed and tabulated under Table.1.energy consumption in the hostel rooms and graphical represented in the figure 7 given above.

TABLE.2. Energy Consumption In Hostel Mess

| Electric load | Quantity | wattage (W) | Daily hours of usage | Kwh used in a day | Kwh used in a year |
|---|---|---|---|---|---|
| Fan | 7 | 75W | 6h | 3.15 | 945 |
| Tube light | 2 | 36W | 8h | 0.576 | 172.8 |
| LED light | 8 | 22W | 8h | 1.408 | 422.4 |
| Sockets | 6 | 65W | 4h | 1.408 | 468 |
| Water purifier | 2 | 300W | 15h | 9 | 2700 |
| Refrigerat-or | 1 | 450W | 24h | 10.8 | 3942 |
| Grinder | 1 | 1500W | 2h | 3 | 600 |
| Exhaust fans | 2 | 65W | 8h | 0.52 | 156 |

The energy consumption in the hostel mess is been tabulated under the Table.2.Energy consumption in the hostel mess and also graphically represented in the above figure.9.

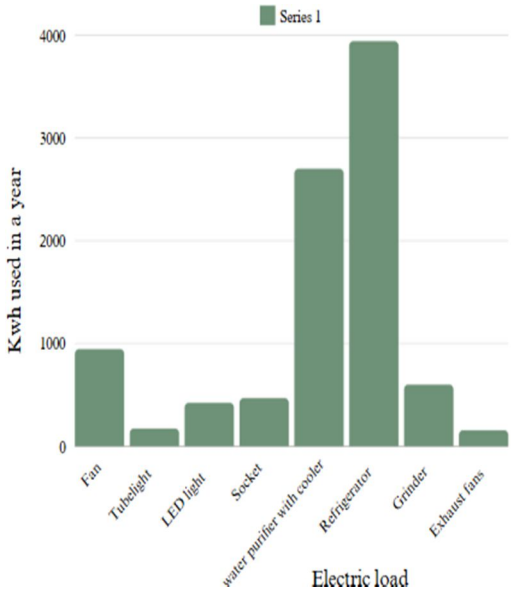



Figure.9.Energy Distribution In The Mess

As per the Audit performed it has found that the over all energy consumed in a year is 45,235.8 Kwh it is also found that the peak month where the energy is consumed at the peak point is in April and base load where the yearly consumption is very low that is on December month. It is also found that these variations is due to the seasonal effects as well as the academic year effect in the summer it is the highest consumption and during winters it has the least consumption

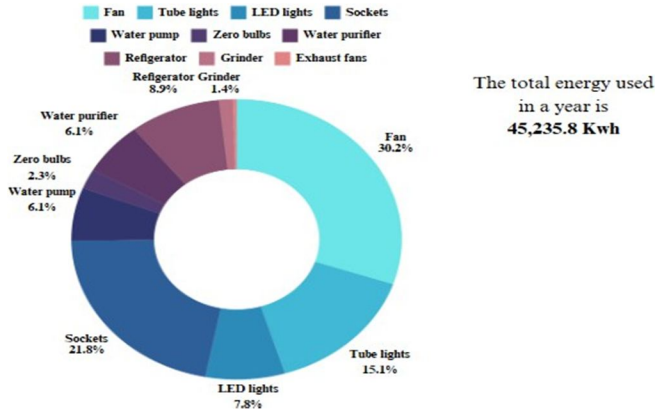



FIGURE.10. Over all Energy Distribution in Hostel

Table.3. Existing energy bill of hostel calculations performed

| AREA | EQUIPMENT USED | NUMBER OF EQUIPMENTS | TOTAL ENERGY CONSUMPTION OF AN EQUIPMENT (PER MONTH) | TOTAL ENERGY COST PER MONTH |
|---|---|---|---|---|
| Accomadation of total rooms=55 | Fan | 55 | 990 KWH | Rs.6930.00 |
| | Tubelights | 75 | 518.4 KWH | Rs.3628.800 |
| | LED bulbs | 57 | 240.76 KWH | Rs.1685.32 |
| | zero bulbs | 40 | 80.64 KWH | Rs.564.48 |
| | sockets | 55 | 343.2 KWH | Rs.2402.40 |
| | power sockets | 9 | 648 KWH | Rs.4536.00 |
| Mess | Fan | 7 | 94.5 KWH | Rs.661.00 |
| | Tubelights | 2 | 17.28 KWH | Rs.120.00 |
| | LED bulbs | 8 | 42.24 KWH | Rs.295.00 |
| | sockets | 6 | 46.8 KWH | Rs.327.00 |
| | water purifier | 2 | 270 KWH | Rs.1890.00 |
| | Refrigerator | 1 | 324 KWH | Rs.2268.00 |
| | Grinder | 1 | 90 KWH | Rs.630.00 |
| | Exhaust fans | 1 | 15.6 KWH | Rs.109.00 |
| exterior | Water pump 1 | 1 | 223.8KWH | Rs.1566.60 |
| | Water pump 2 | 1 | 44.76KWH | Rs.313.32 |
| TOTAL COST PER MONTH= Rs.28,217.32 | | | | |

Total Daily Energy Consumption (kWh) = ∑ (Number of Devices×Power per Device (kW)×Daily .
Annual Energy Consumption=Total Daily Energy Consumption (kWh)×No. of Days in a Year

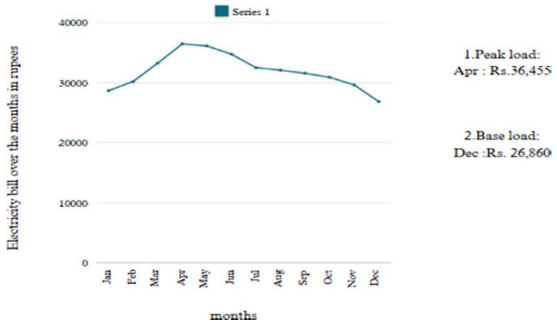



Figure.11. Energy Consumption Annually

## V. ENERGY CONSERVATION MEASURES

### A. *Previous Energy Consumption and Costs*

Total Electricity Bill: ₹28,217 per month High-Energy consumption Appliances: Tubelights: 36W each
Fans: 75W each Refrigerator: 450W

### B. *Energy Efficiency Measures Implemented*

Lighting Upgrades:
Old Tubelights (36W each): Replaced with 20W T-bulbs Energy Savings: 36W - 20W = 16W per bulb saved
Fan Upgrades:
Old Fans (75W each): Replaced with 40W fans Energy Savings: 75W - 40W = 35W per fan saved

### C. *Refrigerator Upgrade*

Old Refrigerator (450W): Replaced with a 300W refrigerator
Energy Savings: 450W - 300W = 150W saved

### D. *New Energy Consumption and Costs*

Reduced Electricity Bill: ₹22,784 per month
Total Savings: ₹28,217 - ₹22,784 = ₹5,469 saved per month
Impact Analysis Financial Benefits:
Monthly Savings: ₹5,469
Annual Savings: ₹5,467 x 12 = ₹65,628

## VI. SUGESSTIONS AND RECOMMENDATION

*1)* Replace all fluorescent and zero watt bulbs with LED T-bulbs (20W)
*2)* Swap existing AC induction ceiling fans (75W) with BLDC fans (35W), which cut power consumption by ~50%.
*3)* Upgrade old refrigerators and grinders to energy- efficient, star-rated models.
*4)* Suggest using solar water heaters for long-term savings despite initial costs.
*5)* Schedule regular maintenance for HVAC, pumps, and other heavy-duty systems
*6)* Include a feasibility analysis with projected ROI for the institution
*7)* Install solar PV panels on rooftops to offset grid dependency and reduce carbon emissions.

## VII. CONCLUSION

The energy audit conducted at PDIT Ladies Hostel has unveiled significant inefficiencies in power usage due to outdated appliances, poor lighting systems, and lack of energy-conscious behaviors. By identifying critical load contributors—such as conventional fans, tubelights, and high-power appliances—the audit outlined targeted upgrades that not only cut monthly energy costs from ₹28,217 to ₹22,784 but also projected annual savings of ₹65,628.


This initiative doesn't just reflect financial optimization; it signals a shift toward environmental stewardship through suggestions like BLDC fan installations, solar water heating, and LED lighting. Moreover, fostering resident awareness and establishing routine maintenance ensures the longevity of these improvements.

Ultimately, the audit serves as a replicable model for institutional hostels seeking sustainable energy practices. The recommended measures will transform PDIT Ladies Hostel into an eco-conscious living space, harmonizing technological upgrades with behavioral change for long- term efficiency and responsible energy use

## REFERENCES

[1] Rupal, P. Syal, S.Sharma, “Energy conservation opportunities in institutional buildings-a case study in India,” IEEE Internation Conference on Power and Renewable Energy (ICPRE), 2017, pp. 664-668
[2] P.S. Magdum, S.R. Lokhande, P.M. Maskar, I.D.Pharne, “A case study:Energy audit at commercial and educationalbuilding,” IEEE International Conference Signals and Instrumentation Engineering(ICPCSI), 2017, pp. 1360-1364
[3] R. Pieterse, A. Kumar, Gerhard P.Hancke, “Energy consumption audit system for smartbuilding,” 40th Annual Conference of the IEEE Electronics Society (IECON), 2014, pp. 3897-3902
[4] R.Sharma and R.K. Jain, “Energy audit of residential buildings to gain energy efficiency credits for LEED certifcation,” International Conference on Energy

Systems and Applications, 2015, pp.718-722
[5] Access to electricity (% of population) - Sub- Saharan Africa | Data.” Accessed: Jan. 15, 2023
[6] W. EA, IRENA, UNSD, World Bank, “Tracking SDG 7: The Energy Progress Report,” Iea, pp. 158–177, 2022, [Online].

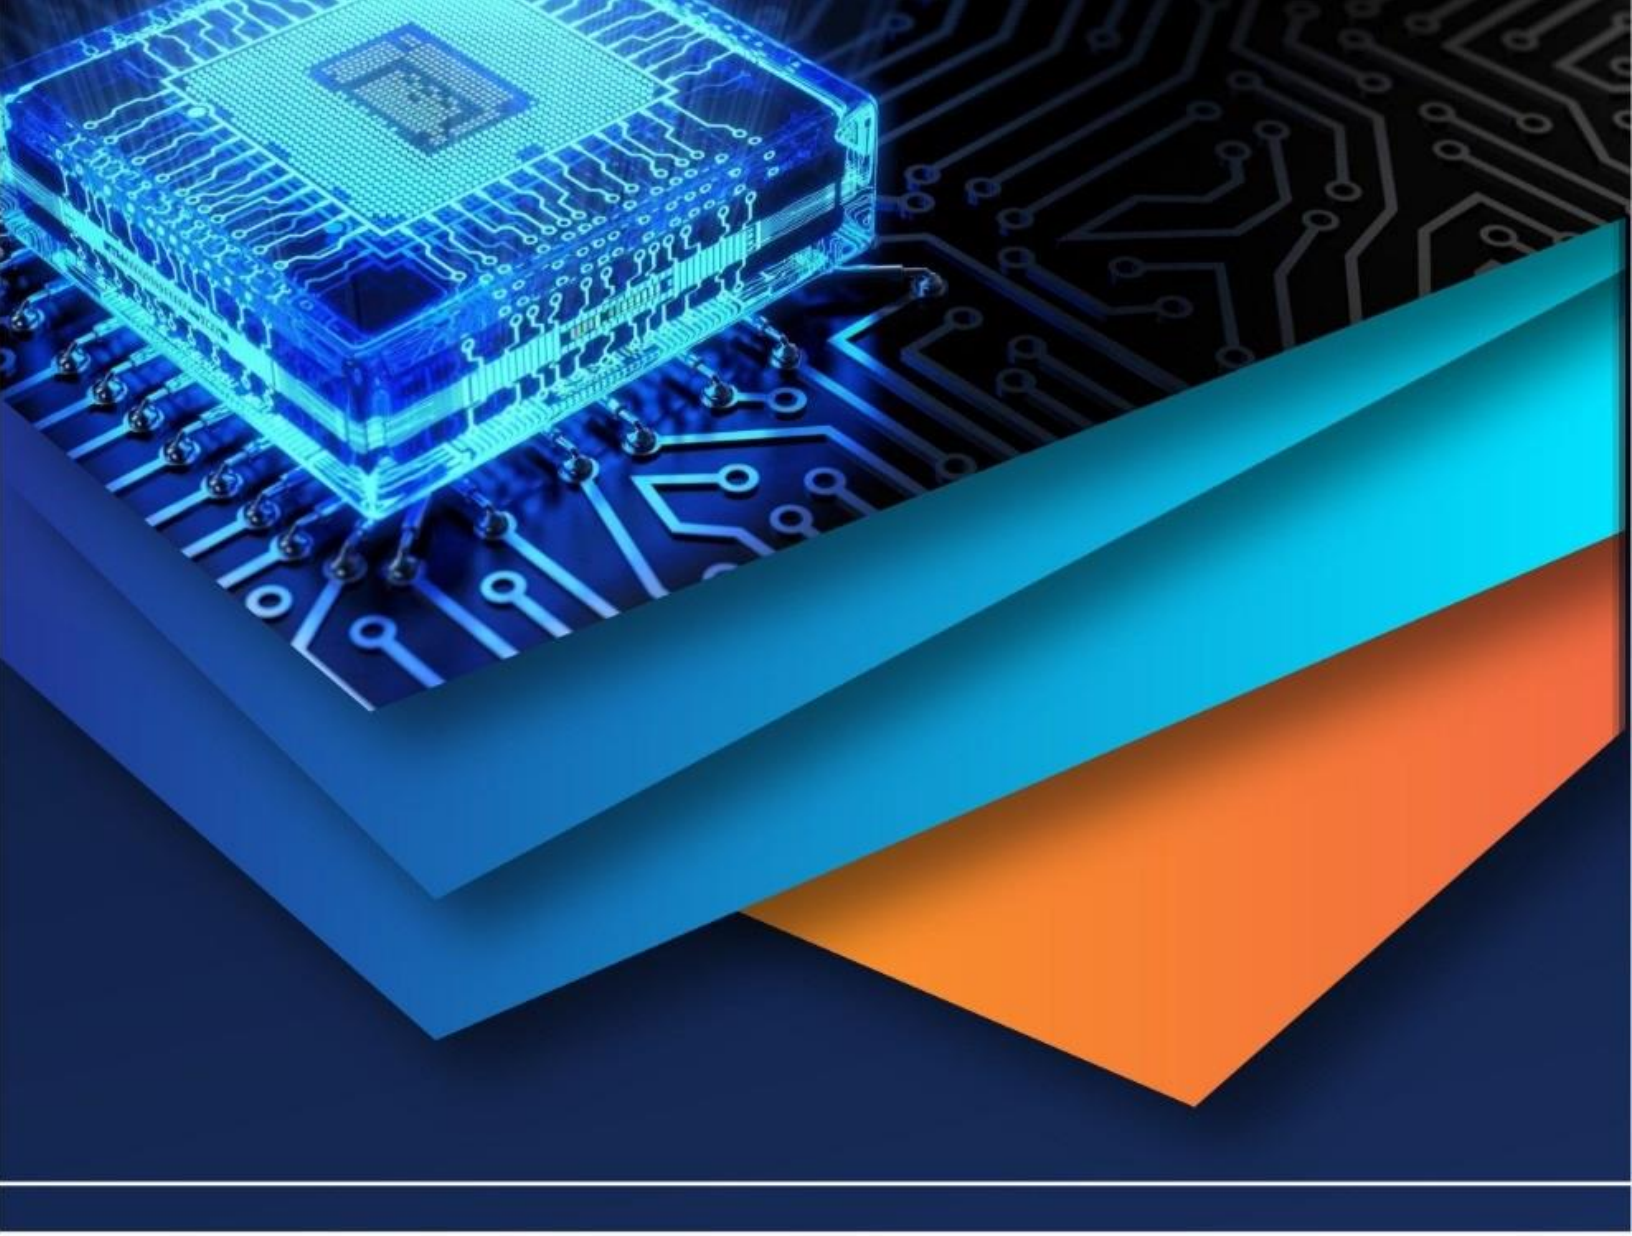

10.22214/IJRASET

45.98

IMPACT FACTOR: 7.129

IMPACT FACTOR: 7.429

# INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

Call : 08813907089 (24*7 Support on Whatsapp)