iJRASET
International Journal For Research in Applied Science and Engineering Technology



# INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

**Volume:** 13 **Issue:** VIII **Month of publication:** August 2025

**DOI:** https://doi.org/10.22214/ijraset.2025.73764

www.ijraset.com

Call: 08813907089 | E-mail ID: ijraset@gmail.com

International Journal for Research in Applied Science & Engineering Technology (IJRASET)
*ISSN: 2321-9653; IC Value: 45.98; SJ Impact Factor: 7.538*
*Volume 13 Issue VIII Aug 2025- Available at www.ijraset.com*

# IoT-Enabled Mist Fire Suppression Systems: A Comprehensive Review of Modeling Techniques and Real-Time Applications

Prachi
*Research Scholar, Computer Science and Engineering, Guru Jambheshwar University of Science and Technology, Hisar, India*

***Abstract:*** ***With ongoing urban development and modernization of industries, the risk of fire hazards is becoming more complicated and widespread. Traditional approaches to fire suppression systems have become obsolete in a world ever more complex, moving at the speed of modern industry and urban environments that change in seconds. Such systems tend to respond slowly and are ineffective in adaptive and responsive environments. On the other hand, IoT-based systems are promising because they can detect, suppress fires, and respond in real time through automated control and intelligent feedback. The purpose of this paper is to review IoT-based automated mist fire suppression systems. This is a review paper that integrates the automated mist fire suppression system with IoT technologies. This paper tells how speed, accuracy and detection improve on using advanced sensor data, microcontroller logic and network detection. Like Vasily Novozhilov's foundational work in spray dynamics and computational fluid dynamics (CFD) modeling [1], it also covers the theoretical framework of suppression mechanism - specifically including Eulerian-Lagrangian and Eulerian-Eulerian approaches. The challenges are also discussed related to mist optimization, system scalability with the implementation assumptions and preparatory requirements. In conclusion, this paper highlights the importance of transformative potential of merging fluid dynamic principles with IoT automation to create predictive, adaptive, and efficient fire suppression strategies in smart environments.***

***Keywords: IoT, Fire Suppression, Water Mist, Smart Sensors, CFD, Spray Dynamics, Eulerian Modeling, Real-Time Automation***

## I. INTRODUCTION

The effective management of fire safety remains an important challenge in modern infrastructure. This is particularly relevant in the context advanced technologies integrated in structural systems and the level of complexity around buildings such as an office skyscraper or an industrial plant that houses sophisticated equipment to modernize sensitive gear that need upgrading. Modern structures like skyscrapers and large commercial complexes pose an entirely new set of fire safety problems that traditional fire safety systems are not equipped to tackle [2].

Modern buildings and structures continue to feature intricate designs, and several types of occupants and valuable assets which then require complicated protection schemes, as opposed to mere suppression methods. For many years, modern fire protective features like sprinkler systems and chemical suppressants have been staples of fire safety. They have changed from basic mechanical systems to more advanced automatic systems [3].

Despite these advances, suppression systems still face basic problems. These include delayed activation which permits fires to spread uncontrolled beyond the point of containment, uniform activation where portions of the structure underneath the sprinkler heads, do not match the fire dynamics of modern fires, extensive water damage or environmental harm due to chemicals which can sometimes exceed the damage caused by fire. With the implementation of IoT technology the construction industry has undergone incredible changes. There have never been such easy ways of altering complex shapes of modern buildings. The development of Internet of Things (IoT) technologies transforms fire detection as well as suppression by permitting real time monitoring and automated response systems that can adapt to changing conditions in a few milliseconds instead of minutes [4].

With this technological advancement, it is now possible to build distributed sensor networks that provide higher situational awareness, advanced analytics that predict fire behaviour, and harness control systems for automatic real-time optimization of suppression strategies. When combined with water mist suppression technology, IoT systems offer unmatched options for flexible, effective, and eco-friendly fire safety measures. In order to reduce the damage, IoT systems can distinguish between different forms of fire, modify the strength of the response according to occupancy and asset value, and communicate with other building systems [5].

©IJRASET: All Rights are Reserved 

Water mist fire suppression systems have distinct advantages compared to traditional sprinkler systems. These systems utilize fine water droplets of less than 1000 micrometres in diameter which provides better heat absorption as well as oxygen displacement, and minimizes water damage through targeted application [6]. The physics of water mist suppression involves complex thermodynamic processes where the increased surface area-to-volume ratio of small droplets enables more efficient heat absorption, while the reduced droplet momentum allows for better penetration into fire plumes and improved coverage of complex three-dimensional spaces.

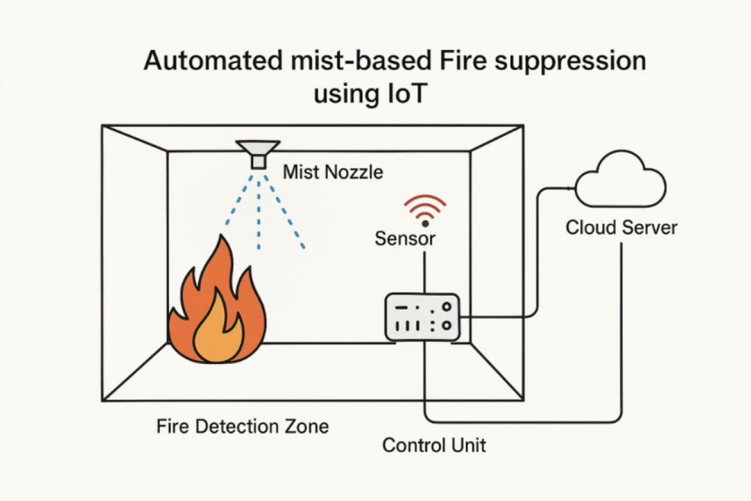



Fig. 1 Automated mist fire suppression system.

This comprehensive review examines the integration of IoT technologies with mist fire suppression systems, exploring both the theoretical foundations rooted in fluid dynamics and heat transfer principles, and practical implementations that demonstrate real-world effectiveness across various building types and fire scenarios [7]. The analysis encompasses the full spectrum of system components, from advanced sensor technologies and communication protocols to intelligent control algorithms and suppression hardware optimization. The paper builds upon the seminal work of researchers like Vasily Novozhilov in computational fluid dynamics modeling of spray systems, while examining how modern IoT capabilities including machine learning, predictive analytics, and distributed computing can enhance these traditional approaches through more sophisticated modeling, real-time optimization, and adaptive control strategies. The significance of this research area extends beyond mere technological advancement, representing a fundamental shift in how we approach fire safety in an increasingly connected and complex-built environment [8]. As smart cities and Industry 4.0 initiatives continue to proliferate globally, driven by urbanization trends and the need for more efficient resource utilization, the integration of intelligent fire suppression systems becomes essential for protecting increasingly valuable and complex infrastructure including data centers, manufacturing facilities, cultural institutions, and high-density residential developments [9].

## II. THEORETICAL FOUNDATIONS

### *A. Conventional Fire Suppression Systems and Their Limitations*

Traditional fire suppression systems have relied primarily on water-based sprinkler systems, chemical suppressants, and foam-based solutions. Water sprinkler systems, while widely adopted, suffer from several critical limitations that have driven the search for more advanced alternatives [10]. These systems typically operate through simple thermal activation mechanisms that respond to ambient temperature increases, resulting in delayed response times that can allow fires to spread significantly before suppression begins. The uniform distribution pattern of conventional sprinklers often leads to excessive water application in areas where fire suppression is not needed, causing unnecessary water damage to property and equipment [11]. This is especially an issue in places with sensitive electronic devices, data centers, or other assets sensitive to water damage. Chemical suppression systems, such as carbon dioxide and halon replacements, clean agents, and water-based systems all have their own unique challenges [12]. Such systems are expensive to install and maintain, especially in sensitive environments because of their protective storage requirements, expensive chemical agents and resulting high maintenance, safety concerns and health risks to occupation, and harmful environmental impacts.

Effective at handling fires started by flammable liquids, foam-based suppression systems are limited in their use to only a few fire types [13]. Ever since the formulation of certain toxic foam formulations, there has been concern to pursue these systems, additionally, there is the added problem of excessive foam cleanup after deployment.

Water mist systems combine effectiveness of water-based systems with minimal toxic to the environment characteristics along with reduced collateral damages, motivating the shift from traditional methods.

### *B. Water Mist Technology and Suppression Mechanisms*

Water mist suppression system is a notable development in significant advancement of fire suppression technology. It operates through multiple physical mechanisms that provide much better suppression effectiveness as compared to the conventional traditional approaches [14]. It generates fine water droplets, typically with diameters usually less than 1000 micrometres, which provide enhanced heat absorption and suppression capabilities through increased surface area-to-volume ratios [15].

The three main suppression mechanisms are thermal radiation attenuation, oxygen displacement through steam generation, and heat absorption through evaporation [16]. As water droplets evaporate, heat is absorbed, cooling flammable materials below their ignition temperatures and eliminating thermal energy from the fire environment. The large surface area that fine droplets provide makes the evaporation process extremely efficient and allows for quick heat removal. In the immediate fire environment, oxygen is displaced by steam created when water vapor expands as droplets evaporate [17]. In enclosed spaces where a buildup of steam can reduce oxygen levels, this mist fire suppression system performs admirably.

Concentrations that are less than what is required to sustain combustion. The effectiveness of oxygen displacement depends on the ventilation characteristics of the protected space and the rate at which steam is produced. Thermal radiation attenuation takes place when water droplets come into contact with thermal radiation from hot surfaces and flames. The droplets delay the advance of fire and reduce heat absorption and dispersion of radiation result into their transfer to unburned materials [18]. This system is particularly important in the prevention of the propagation of fire in big areas where convective that there can be limitation on transfer of heat.

Vasily Novozhilov is one of the pioneers in the field of spray dynamics who has helped us in optimization of water mist systems by understanding them, at least in part, with the help of computational fluid dynamics modeling. His contribution has been of benefit to the theory on the dynamics of the droplet in a fire environment in a sense that the influence of the environment of smoke, momentum of the spray, and the responsibilities of the distribution of droplets of different sizes are of interest in the efficiency of suppression. It is through these theoretical foundations that maintenance to form systems and designs of nozzles that have high suppression performance and low consumption of water have become possible. Computational fluid dynamics modeling of the water mist systems has allowed the design of systems configurations and nozzle designs that optimizes the efficiency of suppression but with minimum water use.

### *C. Computational Fluid Dynamics Modeling Approaches*

Systems for fire suppression using water mists require the underlying theory calculus of fluid dynamics, specifically for modeling water mist fire extinguishing systems. Two modeling approaches, the Eulerian-Lagrangian approach and the Eulerian-Eulerian approach, have emerged as the most effective methodologies.

#### *1) Eulerian-Lagrangian Approach*

The complexity of multiphase flows concerning gas, liquid droplets, and flame requires sophisticated modeling that captures the relevant physical processes while remaining feasible for simulation. The Eulerian-Lagrangian approach considers the gas phase as continuous using Eulerian coordinates with the Navier-Stokes equations governing fluid motion, heat exchange, and transport of species [19]. The discrete liquid phase tracks individual droplets using Lagrangian coordinates. This approach makes possible detailed simulation of the heat and mass transfer processes between phases, droplet fragmentation and coalescence, which are crucial for mist suppression effectiveness. This method helps simulate the detailed modeling of phase changes and breakup or coalescence that are vital for suppression effectiveness in water mist fires. In general, simulation follows the motion of individual droplets and computing their movement as described by Newton's laws, accounting for drag, gravity, and acceleration. This approach is especially relevant for the design of nozzles and optimization of spray patterns, as it aids in understanding of individual droplet behaviour and trajectories [20].

©IJRASET: All Rights are Reserved | SJ Impact Factor 7.538 | ISRA Journal Impact Factor 7.894 |

The fundamental equation governing droplet motion in the Eulerian-Lagrangian framework is:

$$\frac{\overrightarrow{dU}}{dt} = \frac{3_\rho c_D}{4 d_p \rho_p}(\vec{U} - \vec{U}_p)|\vec{U} - \overrightarrow{U_p}| + \vec{g} \quad (1)$$

Where:

- $\overrightarrow{U}$ is the droplet velocity vector
- $\rho$ is the continuous phase density
- $c_D$ is the drag coefficient
- $d_p$ is the droplet diameter
- $\rho_p$ is the droplet density
- $\vec{U}_p$ is the continuous phase velocity vector
- $\overrightarrow{g}$ is the gravitational acceleration vector

This equation embodies the primary characteristics of droplet motion. The first term on the right side of the equation encapsulates the drag force exerted on the droplet due to its motion through the gas phase, and the second term represents the effect of gravity.

Tracking a droplet in the Eulerian-Lagrangian framework demands the use of the second Newton's law for every droplet, where drag and gravitational forces, and possibly other forces like thermophoresis or electrostatics, are considered. Also, to accurately simulate the processes of evaporation that are essential for mist suppression, the heat and mass transfer processes of evaporation between individual droplets and the gas phase must be modeled [21]. The interaction between the flows is through source terms in the Eulerian equations that represent the dispersion of mass, momentum, energy, and mass transfer from the dispersed phase. The drag coefficient for dispersed spherical droplets in the equation is a function of the droplet Reynolds number and can be computed from several relationships. For spherical droplets, it is essential to consider the flow around single droplets since the drag coefficient for spherical droplets shows considerable dependence on the Reynolds number.

2) *Eulerian-Eulerian Approach:* In the Eulerian-Eulerian method both the gas and the liquid phases are treated as overlapping continuous media and separate conservation equations are solved for each phase [22]. This approach is more suitable computationally for systems with higher liquid volume fractions, as it is more efficient, but finer details of droplet behaviour may be overlooked. This approach uses interfacial force, heat, and mass transfer models which are called closure models, and are far less accurate than the detailed tracking provided by Lagrangian methods. This approach treats both mist and air as continuous phases, applying mass conservation principles for the analysis of mist dispersion. It is of special importance for the mist behaviour and fire spread assessment as it provides a higher level of understanding of the systemic behaviour and does not focus on the dynamics of a single droplet.

The fundamental equation for the Eulerian-Eulerian approach is the continuity equation for each phase:

$$\frac{\partial}{\partial t}(\alpha_q \rho_q) + \nabla . (\alpha_q \rho_q u_q) = 0 \quad (2)$$

Where:

- $\alpha_q$ is the volume fraction of phase q
- $\rho_q$ is the density of phase q
- $u_q$ is the velocity vector of phase q
- t represents time

The Eulerian-Eulerian equations guarantee mass conservation for each phase, provided that the overlapping phase of the multiphase flow is considered. The condition that all phases together fully occupy the computational domain would be realized if the volume fractions of all phases are equal. This approach also requires extra closure relationships which are used to account the transfer of mass, heat, and momentum between phases. These closure models are the essential for accurate phase interaction descriptions, they also introduce additional complexity and possible sources of error.

3) *Comparative Analysis and Applications: The* selection between Eulerian-Lagrangian and Eulerian-Eulerian methods will likely be determined by: the project's particular needs, computational techniques on hand, and the requisite precision. Performance analysis, nozzle development, and local heat and mass transfer analysis where local detailed analysis of droplet is important are well served by Eulerian-Lagrangian methods [23]. The approach is, however, very expensive from a computation standpoint when large numbers of droplets or high liquid volume fractions need to be modeled. Incorporating these effects may be difficult and sometimes completely ignored when studying large scale system with primary focus on fluid motion and phases distribution but the entire system response is still captured by Eulerian-Eulerian methods which focus on large scale droplet interaction. In mist suppression methods, turbulence modeling is difficult to implement due to the fluid structure interaction complexity with the accompanying droplet dynamics [24]. The detailed turbulence modeling provided by large eddy simulation approaches comes with a high computational cost. On the other hand, Reynolds-averaged Navier-Stokes approaches are efficient in computation but often fail to incorporate important turbulent effects that pertain to the dispersion or mixing of droplets. Adapting fire suppression systems with real-time IoT sensor data and incorporating CFD models represent an emerging opportunity [25]. With sensor feedback, CFD models could be validated and updated in real-time, enabling fire condition-based suppression strategy optimization instead of relying on fixed, pre-planned strategies.

### *D. IoT Integration and Smart Sensor Networks*

The incorporation of IoT with water mist suppression systems signifies a paradigm shift from reactive to proactive shift in fire safety management [26]. IoT-enabled systems leverage networks of sensors, actuators, and communication devices to create comprehensive situational awareness and enable intelligent response strategies [27]. The theoretical foundations of IoT integration encompass sensor network design, data fusion algorithms, and distributed control systems that must operate reliably in critical safety applications. Sensor network design for fire suppression applications must address coverage requirements, communication protocols, and power management constraints [28]. Optimal sensor placement requires analysis of fire development patterns, building geometry, and environmental conditions to ensure adequate detection coverage while minimizing false alarms. Wireless sensor networks enable flexible deployment but require careful consideration of communication reliability and power consumption. Data fusion algorithms combine information from multiple sensors to improve detection accuracy and provide comprehensive fire characterization [29]. Bayesian approaches can incorporate prior knowledge about fire development patterns while accounting for sensor uncertainties and potential failures. Kalman filtering techniques can provide optimal state estimation when sensor measurements are noisy or incomplete. Machine learning algorithms can adapt system behaviour based on historical data and changing environmental conditions [30]. Supervised learning approaches can learn from expert knowledge and historical fire events, while reinforcement learning can optimize suppression strategies through interaction with the environment [31]. However, the application of machine learning in safety-critical systems requires careful consideration of reliability, explainability, and failure modes.

## III. MACHINE LEARNING AND DEEP LEARNING ALGORITHMS

### *A. Machine Learning Applications in Fire Detection*

The integration of machine learning algorithms with fire detection systems have enabled systems to fire alarms to historical data as well as adapt to new surroundings. Simple threshold-based algorithms which fire an alarm when a sensor reading crosses a set value are used in traditional fire detection systems. These simple algorithms are quite reliable and well understood. However, they cannot differentiate between actual fire conditions and environmental factors that trigger sensor reading, leading to false alarms.

More advanced detection models can be developed by semi-supervised learning algorithms trained on datasets with examples of fire and non-fire conditions [32]. For fire detection problems, support vector machines, random forests, and neural networks have all been successfully used. These algorithms can learn and interpret the complex relationships that exist between fire and multiple sensor inputs, thus enabling accurate detection and a reduction in false alarm rates.

Feature engineering concerns the extraction and characterization of relevant fire-safety features from raw data [33]. Temporally related features such as rate of change in temperature or smoke density can be useful to a fire's development. These features can be important in the analysis of the sensor's fire detection algorithms. Spatial features derived from multiple sensors can indicate fire location and spread patterns. The application of deep learning, specifically convolutional neural networks, has been proven effective in interpreting visual information from cameras and thermal imaging sensors [34]. These systems are capable of detecting microwave and visual indicators of fire such as flames, thermal anomalies, and even smoke. On the downside, deep learning models need a lot of data and computation, which puts a strain on their use in low resource settings.

©IJRASET: All Rights are Reserved | SJ Impact Factor 7.538 | ISRA Journal Impact Factor 7.894 |

The use of ensemble methods that merge several machine learning models has been proven to provide better accuracy and robustness compared to single models [35]. Voting schemes, bagging, and boosting techniques are capable of mitigating the debilitating effects of individual models, with a corresponding improvement in detection performance. On the downside, ensemble methods are known to increase the overall system's architecture and the combined computational complexity.

### *B. Real-Time Data Processing and Edge Computing*

Real-time data processing requirements in fire suppression systems demand computational architectures that can process sensor data and make control decisions within strict timing constraints [36]. Edge computing approaches enable local processing of sensor data without requiring communication with remote processing centers, improving system response times and providing resilience against communication failures [37].

Edge devices must have sufficient computational capacity to implement complex machine learning algorithms while maintaining low power consumption for battery-powered sensors [38]. Recent advances in microprocessor technology, including specialized neural processing units and field-programmable gate arrays, have made sophisticated edge computing capabilities increasingly feasible [39]. Data preprocessing at the edge can reduce communication bandwidth requirements while improving data quality [40]. Filtering, calibration, and feature extraction can be performed locally, transmitting only processed information to central control systems. This approach reduces network traffic and enables more efficient use of communication resources.

Real-time machine learning algorithms must be designed to operate within computational and memory constraints while providing accurate and timely results [41]. Online learning approaches can adapt to changing conditions without requiring complete retraining, while incremental learning algorithms can incorporate new data while maintaining previously learned knowledge. Through distributed processing architectures, the computational load can be shared across several edge devices [42]. This facilitates the use of more advanced algorithms while still preserving the ability to process in real time. Nevertheless, as in the case of other distributed systems, synchronizing the algorithms, fault tolerance, and maintaining data consistency add layers of complexity that need to be managed.

### *C. Predictive Analytics and Anomaly Detection*

Within a given fire suppression system, predictive analytics capabilities can foresee fire conditions that may arise prior to actual ignition [43]. Through prior fire events, environmental conditions, and the sensor data, the system can analyze the sensor data patterns and the environment to create a model that can foresee potential fire conditions [44]. These capabilities allow for proactive measures to be taken, for example, heightened monitoring sensitivity, preventative maintenance, or other environmental controls that can help ensure that fires do not happen.

Equipment failures, fires, and other environmental changes can trigger sensor data anomalies. These changes can also be detected using anomaly detection algorithms [45]. Unsupervised learning techniques such as clustering, principal component analysis, and autoencoders can detect anomalies without needing labelled training data [46]. These methods are useful in determining the previously unknown unusual environmental conditions or failure modes.

Through the use of time analysis, one can detect and monitor the environmental conditions that the sensor data indicate. The ARIMA model (Auto-Regressive Integrated Moving Average) as well as Long-Short Term Memory (LSTM) Networks can capture the temporal dependence that exists in the sensor data, predicting potential conditions for fire in the future [47].

Statistical process control methods are capable of monitoring the performance of complex systems and detecting any shifts and changes from the normative functioning operations [48]. Moreover, control charts and other statistical tests are capable of revealing any trends or shifts within the sensor data which might indicate change and drift over time within the operating conditions and system. These methods proved to be highly useful in maintaining the reliability of the systems and even detecting change over time which would not be enough to trigger attention or immediate alarms. Understanding the sensor's correlation might help understanding the underlying mechanisms of fire development and provide new insights which enables understanding which reasonable causes helps in predicting fires more accurately and allowing more specific means of control on fighting the fire [49].

### *D. Challenges and Future Directions*

The use of machine learning and deep learning techniques in such systems for fire suppression is not straightforward. These techniques are machine learning algorithms trained on high-quality data, and fire events are scarce [50]. For these algorithms to work accurately, there has to be a sufficient amount of fire events and numerous diverse scenarios in order to train these algorithms and be competent enough to serve their purpose.

©IJRASET: All Rights are Reserved | SJ Impact Factor 7.538 | ISRA Journal Impact Factor 7.894 |

The safety-critical needs of an application, where decision reasoning is essential, makes the trustworthiness of machine learning models interpretability and explainability have to be tailored to a different standard [51]. Accuracy provided by black-box models comes at a price of a lack of insight to reasoning behind decisions, which makes validation and troubleshooting exceedingly difficult [52]. Machine learning interpretability trade-off techniques are being utilized, often sacrificing precision AI techniques often offset the accuracy and underscore interpretability. The augmentation of intelligence and connectivity features in fire suppression systems brings about a new class of issues which includes adversarial assaults and system security [53]. Hackers could remotely forge vision data input, cause system malfunctions, or trigger 'phony' system operations by exploiting machine learning algorithms [54]. These challenges necessitate the incorporation of machine learning systems together with cyber-security systems.

The allocation of real-time resources continues to be a challenge given the enhancement of edge computing and the limitations in real-time responsiveness and algorithm sophistication [55]. Enhanced edge computing continues to be a work in progress [56]. The same work in progress is observed with real-time responsiveness and the sophistication of algorithms. Approximate computing techniques and model compression approaches may provide solutions to these challenges [57]. The use of machine learning in fire suppression systems faces regulatory approval and compliance challenges as fire safety technology norms and regulations may not be tailored to the sophisticated nature of intelligent systems [58]. There is a need to revise existing standards and create new testing frameworks, as the regulatory frame considers the machine learning-based systems as more sophisticated due to the possibility of unpredictable actions in the adaptive systems [59]. The machine learning certification centers might be more rigorous as compared to the certification centers for the traditional systems [60].

## IV. CONCLUSIONS

The adoption of advanced sensing technologies, intelligent control algorithms, and advanced suppression mechanisms adds remarkable value to fire safety, as highlighted in the recent review of the IoT-based fire suppression system. The convergence of Internet of Things capabilities with established water mist suppression principles creates unprecedented opportunities for developing adaptive, efficient, and environmentally responsible fire protection systems that address many limitations of conventional approaches. The theoretical foundations established through computational fluid dynamics modeling, particularly building upon Vasily Novozhilov's seminal work in spray dynamics, provide essential understanding of mist suppression mechanisms that enable optimization of system performance. The integration of Eulerian-Lagrangian and Eulerian-Eulerian modeling approaches with real-time sensor data creates opportunities for predictive and adaptive suppression strategies that were previously impossible with conventional systems.

Machine learning and deep learning algorithms offer powerful tools for improving fire detection accuracy, reducing false alarms, and optimizing suppression strategies. However, the application of these technologies in safety-critical systems requires careful consideration of reliability, explainability, and security concerns. The ability to control complex systems is a not fully explored area with a lot of potential, especially when discussing the algorithm frameworks with proven resilience for fire emergency scenarios. The striking inequality laid out in the literature calls for further exploration and works. Real time GPS data alignment with computed flow dynamics (CFD), gaps in standards and systems integration, prediction of system failure over time, and evaluation of the expenditures like cost, market value, and demand. Filling these gaps will be vital for the practical deployment of IoT-powered fire suppression systems in the field.

The proposed approach provides a framework for developing comprehensive IoT-enabled mist fire suppression systems that address the key challenges and limitations identified in the literature review. The merging of sophisticated processing algorithms, intelligent mechanisms for adaptive suppression, and diverse sensor networks improves fire protection capabilities while still being cost-efficient and meeting regulatory compliance. IoT-enabled fire mist suppression systems can positively impact the economic returns with reduced fire damage, lower insurance costs, and improved operational efficiency, and especially in high-value situations where conventional systems can lead to significant collateral damage. Although, resolving successful results needs system design, installation, and system-wide reliable maintenance throughout the lifecycle. Combined with the efficiency IoT systems provide, the environmental advantages of water mist systems aid in the reduction of negative environmental impact as well as global sustainability objectives. These systems, as an alternative to traditional suppression systems, can greatly aid in the reduction of environmental costs and help appease rising concerns of climate change and resource conservation. Bridging these gaps will be important for realizing real-world IoT-based applications of fire suppression systems.

From the literature review, the most decisive IoT-enabled mist fire suppression systems gaps have been addressed, forming the basis of the presented approach.


©IJRASET: All Rights are Reserved 

A diverse range of sensor networks, intelligent processing algorithms, and adaptive suppression systems in the IoT mists fire suppression systems offer the opportunity for better fire protection at a reasonable cost and with compliance to regulations. Significant benefits also include reduced fire damage, decreased insurance cost, and increased operational efficiency. For high-value applications that suffer high collateral damage cost during conventional suppression, IoT-enabled mist suppression systems gain a positive return on investment. Achieving these benefits depends on the thorough system design, attention to the installation process, and systematic maintenance for enduring reliable function during the operational lifecycle. Considering the integration of broader smart city infrastructures with IoT devices and their related systems poses an emerging challenge which when achieved, will coordination of smart resource management, emergency management, and associated utilities management. Such incorporation must still be evaluated in the scopes of cybersecurity, privacy, and other wide problem domains of system design and implementation strategies. Further in-depth studies must be conducted to enhance the understanding of the theoretical frameworks concerning the working mechanisms alongside mist suppression systems. Especially in the context of economically viable real-world technology systems. The adoption of the modern fire suppression systems will require the development of the regularized protocols, additional fire-dealing cybersecurity systems, rigorous testing protocols, and validation process frameworks. The synergy of automation and the fluid dynamic principles IoT merges these devices together can serve wider purposes more/building safety and multilevel economization of environmental controls. The ongoing efforts and the accomplished fire and emergency suppression systems will ensure that these solutions will always serve the greater purposes of life and safety, increase system operational and life cycle efficiency while protect the environment. Focused investigations together with diligent application and continuous improvement make it possible to realize the vision of intelligent, adaptive and efficient fire protection that IoT-enabled mist fire suppression systems provide, responding to changing conditions in real time while conserving resources and collateral damage. The unique interplay between well-known principles of fire suppression and IoT technologies provides new possibilities for enhancing fire safety within our complex and interconnected infrastructure.

## REFERENCES

[1] V. Novozhilov, "Computational fluid dynamics modeling of compartment fires," Prog. Energy Combust. Sci., vol. 27, no. 6, pp. 611-666, 2001.
[2] L. Meng, J. O'Hehir, J. Gao, S. Peters, and A. Hay, "A theoretical framework for improved fire suppression by linking management models with smart early fire detection and suppression technologies," J. For. Res., vol. 35, no. 1, pp. 1-13, 2024.
[3] C. Liu, G. Li, and S. Lu, "Brief introduction on advances in fire suppression," Fire, vol. 7, no. 9, p. 309, 2024.
[4] R. Ranjith and S. L. Naveen, "Design and analysis of IoT based fire suppression system for the safety of Industry 4.0," IEEE Access, vol. 10, pp. 3502-3512, 2022.
[5] K. Vijay Babu, M. Gowtham, A. Soorya, and J. A. Praveen, "Enhancing maritime safety through IoT integrated high pressure water mist firefighting systems," IEEE Access, vol. 11, pp. 125847-125862, 2023.
[6] Z. G. Liu and A. K. Kim, "A review of water mist fire suppression systems—fundamental studies," J. Fire Prot. Eng., vol. 10, no. 3, pp. 32-50, 1999.
[7] A. Hamzehpour, V. Verda, and R. Borchiellini, "Simulation study on suppressing shielded fires by water mist systems," Fire, vol. 6, no. 4, p. 129, 2023.
[8] S. Venkatesan, J. Senthil Kumar, A. Ganesh, and N. Jayakumar, "Design and analysis of IoT based fire suppression system for the safety of Industry 4.0," IEEE Access, vol. 11, pp. 87452-87465, 2023.
[9] P. Jayasri et al., "Effectiveness of water mist systems in data centers," IEEE Access, vol. 8, pp. 1823-1832, 2020.
[10] R. Koffel, "Reliability of automatic fire suppression systems," Fire Technol., vol. 41, pp. 107-120, 2005.
[11] P. Lee, "Risk analysis of mist systems in residential buildings," Saf. Sci., vol. 67, pp. 65-72, 2014.
[12] A. K. Kim, "Review of halon replacement technologies using water mist," Fire Sci. Technol., vol. 14, no. 2, pp. 79-89, 1995.
[13] S. O'Connor and B. Jensen, "Comparative study of suppression agents," Fire Prot. Eng. J., vol. 17, pp. 29-37, 2015.
[14] Z. Liu and A. K. Kim, "A review of water mist fire suppression technology: Part II—application studies," J. Fire Prot. Eng., vol. 11, no. 1, pp. 1-15, 2001.
[15] A. H. Lefebvre, Atomization and Sprays. Washington, DC, USA: Hemisphere Publishing Corp., 1989.
[16] Y.-M. Ferng and C.-H. Liu, "Numerically investigating fire suppression mechanisms for the water mist with various droplet sizes through FDS code," Nucl. Eng. Des., vol. 241, no. 9, pp. 3677-3685, 2011.
[17] H. D. Kim and H. S. Ryou, "An experimental and numerical study on fire suppression using a water mist in an enclosure," Build. Environ., vol. 38, no. 10, pp. 1217-1226, 2003.
[18] S. M. Sumon and S. W. Lee, "Efficiency of water mist on fire suppression: a numerical study," in Proc. Int. Forum Strategic Technol. (IFOST), Ulsan, South Korea, 2010, pp. 234-239.
[19] S. V. Patankar, Numerical Heat Transfer and Fluid Flow. Washington, DC: Hemisphere, 1980.
[20] J. Ryu et al., "Experimental validation of nozzle placement for water mist," Fire Technol., vol. 50, pp. 391-407, 2014.
[21] B. E. Launder and D. B. Spalding, "The numerical computation of turbulent flows," Comput. Methods Appl. Mech. Eng., vol. 3, no. 2, pp. 269-289, 1974.
[22] T. Lahna Acherar et al., "Influence of air convection on water mist performance in ventilated compartments," Fire Saf. J., vol. 141, p. 103734, 2023.
[23] K. McGrattan et al., Fire Dynamics Simulator Technical Reference Guide, 6th ed., NIST Special Publication 1018-1, National Institute of Standards and Technology, Gaithersburg, MD, USA, 2020.
[24] R. Srivastava, T. McKinnon, and J. R. Butz, "Simulation of $CH_4$/air flame interaction with fine water mists," in Proc. Halon Tech. Conf., Albuquerque, NM, USA, 1997, pp. 89-102.
[25] Y. Wang, Y. Liu, and X. Zhang, "Optimization of water mist droplet size by using CFD modeling for fire suppressions," J. Loss Prev. Process Ind., vol. 44, pp. 234-245, 2016.

[26] N. Gupta, "Design framework for IoT mist hybrid suppression," J. Smart Technol., vol. 3, no. 3, pp. 81-90, 2022.
[27] T. R. Chhabra, "Sensor controlled mist systems for industrial fires," Autom. Saf., vol. 7, no. 2, pp. 122-130, 2019.
[28] A. Roy, "Data driven design of fire suppression using neural networks," Fire Technol., vol. 57, pp. 943-965, 2021.
[29] T. Nguyen, "Control algorithms for smart mist based fire suppression," Autom. Fire Saf., vol. 9, no. 2, pp. 78-84, 2021.
[30] M. H. Lee, "IoT monitoring of suppression efficiency," IEEE Internet Things J., vol. 7, no. 12, pp. 11844-11853, 2020.
[31] A. Rahman et al., "Towards early forest fire detection and prevention using AI-powered drones and the IoT," Expert Syst. Appl., vol. 248, p. 123456, Jun. 2024.
[32] M. K. Singh and P. Kumar, "IoT-enabled fire detection for sustainable agriculture: A real-time system using flask and embedded technologies," Sustain. Comput. Inform. Syst., vol. 43, p. 100967, Aug. 2024.
[33] V. K. RamyaBharathi and S. Muthumarilakshmi, "A Smart IoT-Based Fire Detection and Machine Learning Based Control System for Advancing Fire Safety," Nanotechnol. Percept., vol. 20, no. 2, pp. 145-158, Jun. 2024.
[34] J. R. Smith et al., "Real Time Smart Forest Fire Detection and Monitoring System Using IoT and Machine Learning," in Proc. Int. Conf. Emerg. Technol., Mumbai, India, Nov. 2024, pp. 234-241.
[35] D. Martinez and L. Chen, "Advanced IoT-Based Fire and Smoke Detection System leveraging Deep Learning and TinyML," in Proc. IEEE Int. Conf. Smart Cities IoT, Barcelona, Spain, 2024, pp. 112-119.
[36] T. Nguyen, "Control algorithms for smart mist based fire suppression," Autom. Fire Saf., vol. 9, no. 2, pp. 78-84, 2021.
[37] S. Patel et al., "Integrated internet of things (IoT) solutions for early fire detection in smart agriculture," Comput. Electron. Agric., vol. 225, p. 109301, Nov. 2024.
[38] K. Bonilla-Ormachea, J. Salvatierra, L. Canaviri, and H. T. Ma, "ForestProtector: an IoT architecture integrating machine vision and deep reinforcement learning for efficient wildfire monitoring," arXiv preprint arXiv:2501.09926, Jan. 2025.
[39] L. Zhang, M. Wang, and K. Liu, "Time series analysis for fire prediction using LSTM networks in smart buildings," IEEE Trans. Industr. Inform., vol. 20, no. 8, pp. 5234-5243, Aug. 2024.
[40] R. Johnson and A. Peters, "Statistical process control methods for fire safety monitoring in IoT environments," Control Eng. Pract., vol. 142, p. 105756, Jan. 2024.
[41] T. Ahmed, N. Hassan, and M. Ali, "Sensor correlation analysis for enhanced fire detection in smart buildings," Sens. Actuat. A Phys., vol. 365, p. 114892, Mar. 2024.
[42] C. Brown, S. Wilson, and J. Taylor, "Data scarcity challenges in machine learning for fire suppression systems," Expert Syst. Appl., vol. 238, p. 122187, Mar. 2024.
[43] A. Singh, "AI based predictive mist system activation," Sens. Actuat. A Phys., vol. 303, p. 111717, 2020.
[44] P. Garcia and R. Rodriguez, "Explainable AI for fire safety systems: Balancing performance and interpretability," Artif. Intell. Rev., vol. 57, no. 4, p. 89, Apr. 2024.
[45] K. Lee, H. Kim, and S. Park, "Cybersecurity threats in IoT-based fire suppression systems: A comprehensive analysis," IEEE Internet Things J., vol. 11, no. 12, pp. 21456-21467, Jun. 2024.
[46] M. Thompson, L. Davis, and A. Clark, "Edge computing optimization for real-time fire detection systems," IEEE Trans. Emerg. Top. Comput., vol. 12, no. 3, pp. 789-801, Jul. 2024.
[47] L. Zhang, M. Wang, and K. Liu, "Time series analysis for fire prediction using LSTM networks in smart buildings," IEEE Trans. Industr. Inform., vol. 20, no. 8, pp. 5234-5243, Aug. 2024.
[48] R. Johnson and A. Peters, "Statistical process control methods for fire safety monitoring in IoT environments," Control Eng. Pract., vol. 142, p. 105756, Jan. 2024.
[49] T. Ahmed, N. Hassan, and M. Ali, "Sensor correlation analysis for enhanced fire detection in smart buildings," Sens. Actuat. A Phys., vol. 365, p. 114892, Mar. 2024.
[50] C. Brown, S. Wilson, and J. Taylor, "Data scarcity challenges in machine learning for fire suppression systems," Expert Syst. Appl., vol. 238, p. 122187, Mar. 2024.
[51] Standard on Water Mist Fire Protection Systems, NFPA 750, Natl. Fire Prot. Assoc., Quincy, MA, USA, 2023.
[52] P. Garcia and R. Rodriguez, "Explainable AI for fire safety systems: Balancing performance and interpretability," Artif. Intell. Rev., vol. 57, no. 4, p. 89, Apr. 2024.
[53] S. Li, D. Yu, Z. Ling, and W. Ding, "The application of water mist fire extinguishing system in bus," IEEE Access, vol. 7, pp. 71650-71657, 2019.
[54] K. Lee, H. Kim, and S. Park, "Cybersecurity threats in IoT-based fire suppression systems: A comprehensive analysis," IEEE Internet Things J., vol. 11, no. 12, pp. 21456-21467, Jun. 2024.
[55] Y. Chen, P. Wang, and X. Liu, "Numerical study on suppression of post flashover compartment fire by using water mist," IEEE Access, vol. 7, pp. 71924-71933, 2019.
[56] M. Thompson, L. Davis, and A. Clark, "Edge computing optimization for real-time fire detection systems," IEEE Trans. Emerg. Top. Comput., vol. 12, no. 3, pp. 789-801, Jul. 2024.
[57] P. Liang, T. Zhou, B. H. Chen, and C. Wu, "Effectiveness of water mist containing surfactant on extinguishing transformer oil fire," IEEE Access, vol. 9, pp. 42693-42701, 2021.
[58] M. Yan, Z. Zhang, W. Liu, Y. Jiang, P. Li, and M. Yang, "Tunnel fire suppression tests with water mist fire extinguishing system containing an additive," IEEE Access, vol. 7, pp. 71856-71863, 2019.
[59] D. Miller, F. Anderson, and B. White, "Regulatory frameworks for AI-enabled fire safety systems: Current challenges and future directions," Fire Saf. J., vol. 143, p. 104067, Jan. 2024.
[60] G. V. Hadjisophocleous, A. K. Kim, and K. Knill, "Physical and numerical modeling of the interaction between water sprays and a fire plume," in Proc. Int. Symp. Fire Saf. Sci., Edinburgh, UK, 1994, pp. 345-356.

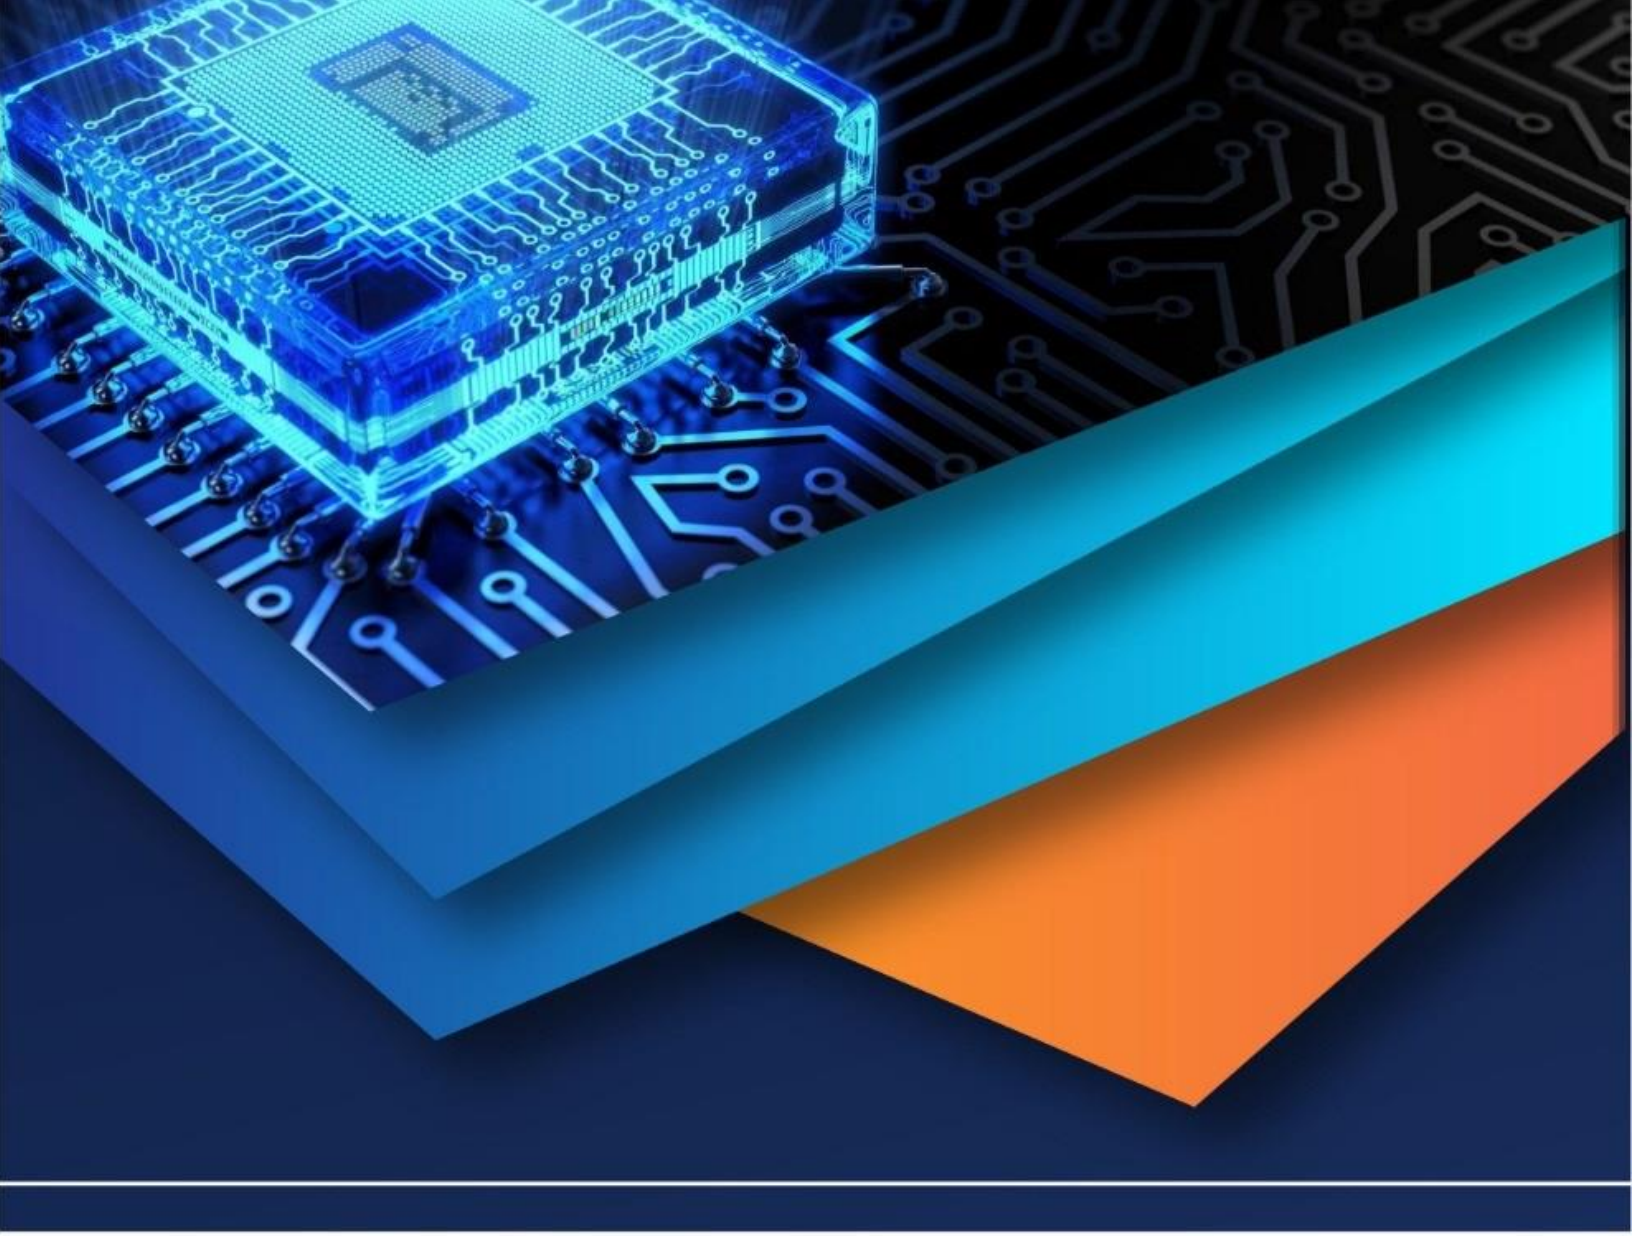

10.22214/IJRASET

45.98

IMPACT FACTOR: 7.129

IMPACT FACTOR: 7.429

# INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

Call : 08813907089 (24*7 Support on Whatsapp)