iJRASET
International Journal For Research in Applied Science and Engineering Technology



# INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

**Volume:** 12 **Issue:** VIII **Month of publication:** August 2024

**DOI:** https://doi.org/10.22214/ijraset.2024.63928

www.ijraset.com

Call: 08813907089 | E-mail ID: ijraset@gmail.com

International Journal for Research in Applied Science & Engineering Technology (IJRASET)
*ISSN: 2321-9653; IC Value: 45.98; SJ Impact Factor: 7.538*
*Volume 12 Issue VIII Aug 2024- Available at www.ijraset.com*

# Multi-criteria Decision Making Methods and sustainable Appliations in the Digital Age

Chandarani Sutar[1], Dr. Deependra Singh[2], Dr. K. S. Verma[3]
[1]*Department of Electrical Engg., RRSIMT Amethi, UP, India*
[2, 3]*Department of Electrical Engg., KNIT, Sultanpur, UP, India*

***Abstract:*** ***Designing a sustainable electrification system for remote places in developing countries is very complex while considering various factors such as technical, economic, environmental and social (TEES). Development of an efficient, rational, coherent and a translucent framework is required to address issues related to the requirement of energy needs based on the end user. The main goal of this research is to design a methodological framework based on decision analysis and optimized model with locally available energy sources. The new optimal renewable energy options are required to be used to minimize the fossil fuel dependency of electrical generation. Initially, suitable energy alternatives are selected by considering different criterion with multiple scenarios for decision analysis. The further optimal combination of energy sources evaluated for different possibilities. The new methodology of hybrid renewable optimization is applied to a rural place, Himachal Pradesh to illustrate its effectiveness based on metrological data.***

***The case study result shows that new methodology gives a real-time optimized system with multiple system combinations and configuration with the use of multitasking decision algorithm. This optimized system found very impactful on its technical feasibility, environment, economy and social factors (TEES) for the considered location.***

***Keywords: Renewable Energy Soucres,Demand side managment , Energy consumption, Wind energy, Battery, Hydro, Hybrid system, Optimization.***

## I. INTRODUCTION

According to the survey of international energy agency (IEA), the energy sector is facing many challenges that have obstructed the growth and full utilization of the crucial energy resources. The cost of high upfront installation and implementation of advanced control equipment with limited financing supports for project developers. The task to establish energy solution becomes very challenging due to lack of business maturity, less purchasing power at consumers level, small and remote dispersed consumers with a low density of population of local and remote locations. Communities low-income levels adversely affect agriculture conditions due to little employability[3].

Approximately 40% population of India are living in remote villages. The comprehensive growth of villages can create a positive impact on development and GDP growth. The proposed case study is considered for remote community of Himachal Pradesh, which is not connected to the grid network and road transport accessibility is also not available throughout the year due to the adverse environmental condition. The electricity of remote community totally depends upon diesel generators. Diesel generator contributes highest cost electricity consumption, which is 10 times more than on the average cost of hybrid renewable generation. Therefore a hybrid renewable generation can be utilized to ensure a power supply of quality, reliability, affordability. It can also provide increased sustainability assessment of advanced energy technology and further helps to reduce greenhouse gas emission and global warming effects[4]. The invariant nature of renewable energy sources creates power quality problems, therefore, the option of utilization of energy storage devices with new beneficial services provides new market space by reducing the cost of the battery. Advancement of new manufacturing technologies provides compactness and large-scale storage property. Most preferred batteries with their specific merits are sodium - sulpher (Na_S), having highest energy density and longest life with the use of nickel-cadmium (Ni_Cd), Lead acid batteries for cheapest cost and lithium-ion batteries for its best properties.

Battery charging status with maximum and minimum settings will depend upon the rate of self-discharging and its current ratings.

Most of the research literature emphasize towards optimization of a combined generation with consideration of its design criteria, specific location, planning and implementation, cost minimization, providing reliability for solving the economic problem.

The proposed multi-decision algorithm provides a better solution to regulate power outage and reduces dependency on fossil fuels which involves saving of high oil expenditure. It also provides reduced greenhouse gases emission, climate resilience, advance development, optimum renewable priorities with cost reduction.

©IJRASET: All Rights are Reserved 

*ISSN: 2321-9653; IC Value: 45.98; SJ Impact Factor: 7.538*
*Volume 12 Issue VIII Aug 2024- Available at www.ijraset.com*

## II. RENEWABLES IN INDIA

In the county total renewable power generation capacity has reached the level of 310 GW. The power generation includes a combination of 13.9% of Hydro, 69.4% of Thermal, 1.9 % of Nuclear energy and Renewable energy of 14.8 %. The renewable generation has achieved IInd level after thermal energy and further expanding its range at the very high rate.

The target of renewable power capacity has increased by the government of India to 175 GW which consist of wind, solar, bio and small hydro of 60 GW, 100 GW, 10 GW, and 5 GW respectively. The set target is to be accomplished by the year 2022. Wind energy capacity generated till 31 March 2018 was 34,046 MW and it took India to the fourth position in the world.

The Government has set a target of 5 GW for SHP projects. Ministry of New and Renewable Energy has been assigned to develop SHP projects of capacities up to 25 MW. Currently, the number of sites for SHP is approx 7200 and power capacities up to 21188.69 MW are identified by Govt. agencies as well as Private developers[8].

## III. FACTORS OF EVALUATION

Optimization of the renewable system is a very challenging task due to invariant performance characteristics of different renewable Sources. The presented research implements a multi-objective decision methodology to achieve the objective of research work. The main four prominent factors are considered here for the evaluation of proposed method efficiency for hybrid system considering its technical, economic, social, environmental and cultural impacts[33].

### *A. Technology Criteria*

The technological criteria consist of system performance with technical efficiency and risk of system operation. The details are as follows:

#### *1) The efficiency of Power Sources*

It is the main parameter of generation components. Efficiency includes the proper utilization of renewable sources for fulfilling the desired limit of energy consumption. The efficiency of the hybrid renewable system depends upon factors such as solar radiations, wind speed variations, load demand and implemented control strategies.

$$\text{Efficiency}(\dot{\eta}) = \frac{\text{Real power output}(P_{Real})}{\text{Nominal Power output}(P_{out})} \qquad (1)$$

#### *2) Reliability of System*

It is a very crucial factor for designing of the hybrid renewable system. Hybrid renewable system reliability depends on the reliability of system component based on different operating modes while generated power must fulfill power demand or deficits caused by the unmet load. The reliability is measured by indices such as Loss of Power Supply Probability (LPSP), Probability of Unmet load (POUL), Loss of Load Hours (LOL), Level of system performance(LOSP), Average interruption of frequency Index (AIFI) and Average time of recovery.

The probability can be calculated as follows

Case 1: when all generator out of service

$$\text{Probability} = \Pi_{i=1}^{n} FOPi \qquad (2)$$

Case 2: when all generator are in service

$$\text{Probability} = \Pi_{i=1}^{n} (1 - FOPi) \qquad (3)$$

The calculation of these values is made by the exploring energy balances and the possible design of the electrical scheme.

#### *3) Installation Risk*

Installation risk may occur in case implemented technology does not work properly under prescribed conditions due to fake or wrong manufacturers information, design errors, damage of parts, down performance to meet expected values. The criteria can be calculated by the deterioration of equipment performance parameters.

The probabilistic approach includes a set of quantitative low, medium and high probability criteria of damage/deterioration.

$$\text{Probability P} = \{\text{Low,Medium,High}\} \qquad (3)$$

©IJRASET: All Rights are Reserved 

*4) Security of Power Supply*

The security of power supply depends on the probability of fuel reliability. Generation source is called secure or reliable when it is enough to maintain continuity of electricity. The fuel security issues may arise due to fluctuating fuel prices as per international business and also disruption may be caused by geopolitical disturbance. This criterion can be evaluated by the statical calculation of fuels with its low, medium and high probability by consultation of experts.

$$\text{Probability } P_{security} = \{Low, Medium, High\} \quad (4)$$

*B. Economical Criterion*

Economic efficiency of the power system is the ratio of the effect of economic results to cost influences by this results. The cost of investment and its output results called higher economic efficiency. The factors considered to indicate economic efficiency are system investment, production cost, revenue obtained, low payback time and increased probability. Levelized cost ($Lc_{ost}$) and cost of energy are prime project indicators.

$$L_{cost} = \frac{\text{lifetime costs}}{\text{lifetime expected power output}} \quad (5)$$

*1) Services Access Time*

It is the time required in case of breakdown for completion of repair. It calculates the number of hours to be required for complete repairing of unit and repairing of time includes from 0 to several hours leads to many days. It creates a database which can minimize repetitive work and can be taken for manufacturer guarantee in future repairing experiences.

$$P_{business} = \{< \text{one hour}, > \text{one hour, one day}, > \text{one day}\} \quad (6)$$

*2) Market business risk*

It is a risk factor on market or business due to growing taxes, cancellation of subsidies, sudden growth in the price of components and not paid guarantees. Market risk can be measured by quantitative criteria of low, medium and high risk. It can be minimized by consulting with companies experts and project team leaders.

$$\text{Probability } P_{business} = \{Low, Medium, High\} \quad (7)$$

*3) Difficulties in administration*

Issues concerned with the implementation of project and investment comes under administrative complexity criteria. It can be evaluated with low, medium and high quantitative complexity criteria and data can be taken for evaluation from federal, regional and local rules and regulations.

*C. Environmental Impacts*

Renewable power generation has large impacts on the environment such as greenhouse gases, change in climate, pollution index, depletion of resources and damage of localized ecosystem.

*1) Green House Gases Emission*

It includes the GHS like carbon dioxide $CO_2$, Methane $CH_4$, Nitrous oxide $N_2O$, Ozon $O_3$, chlorofluorocarbons CFCs and hydrofluorocarbon HCFCs. $CO_2$ emissions($E_{co2}$) is annual produced electricity, W (kWh) by the average annual emissions ($E_{average}$) for the certain power system.

$$E_{co2} = W * E_{average} \quad (8)$$

*2) Influence our Local Ecosystem*

The local ecosystem includes influence during operation and construction for example:

- wind power- Loss due to the influence of birds and bats, noise, vibration, change in the landscape
- PV panel- The occupation of agriculture land, diesel include noise and vibration

$$\text{Probability } P_{influence} = \{Zero, Low, Medium, High\} \quad (9)$$

*3) Resource Depletion*

The amount of Reservoir used during the operation or during the life of power generation.

$$\text{Probability } P_{depletion} = \{Zero, Low, Medium, High\} \quad (10)$$

*D. Social Criteria*

Increased rate of employment or increase on welfare or increase of job opportunity to the local community in that region. The social criteria of welfare can be evaluated by no influence, low, medium and significant influence.

$$\text{Probability } P_{social} = \{\text{Zero,Low,Medium, significant }\} \quad (11)$$

*1) Consistent with the local policy(LP)*

Government is applying different measures in form of green certificate awards and allowances for low emission pollution. The quota system is influenced by the decision of power system designer's evaluation criteria which include zero, partly or fully consistency.

$$\text{Probability } P_{LP} = \{\text{Not,partially,fully }\} \quad (12)$$

*2) Adoption of Technology by Public*

It is the public willingness to adopt new technology by paying money for green energy. Number of ecological problems and consciousness about the sources depletion growth goes many years for acceptance of the project.

Decision task for a sustainable plant model is based on four factors and influenced by sub-criteria for development of the community and it needs to be related with the growth of the person living in remote areas in the terms of their experiences, motivation, and values. Any community is reliance on the health of every part of the community and its effective growth for all over development covering many regions. Impact of profit planning and ecosystem on human society and its biosphere parts generates a vibrant culture and emphasis should be given on tourism, arts, festival, history, economy, social development, traditional seasonal business market value employability and tourism in that region.

TABLE I. EVALUATION CRITERIA

| Criteria | Parameters | Factor | Remark |
|---|---|---|---|
| Technical criteria | Power efficiency | $C_1$ | MAX |
| | LOLP/SPL/SAIFI, | $C_2$ | MIN |
| | Construction risk | $C_3$ | MIN |
| | The probability of fuel undersupply | $C_4$ | MIN |
| Economic criteria | Leverized costs or minimum electricity price | $C_5$ | MIN |
| | Business risk | $C_6$ | MIN |
| | The complexity of administrative issues | $c_7$ | MIN |
| | Time to access the service, | $C_8$ | MIN |
| Environmental criteria | The amount of GHG gases, kg/year | $C_9$ | MIN |
| | The number of other air pollutants, kg/year | $C_{10}$ | MIN |
| | Influence on the local ecosystems | $C_{11}$ | MIN |
| | Resources depletion | $C_{12}$ | MIN |
| Social criteria | Consistency with the local police | $C_{13}$ | MAX |
| | The increase of welfare in the region | $C_{14}$ | MAX |
| | Acceptance of new technologies by people | $C_{15}$ | MAX |

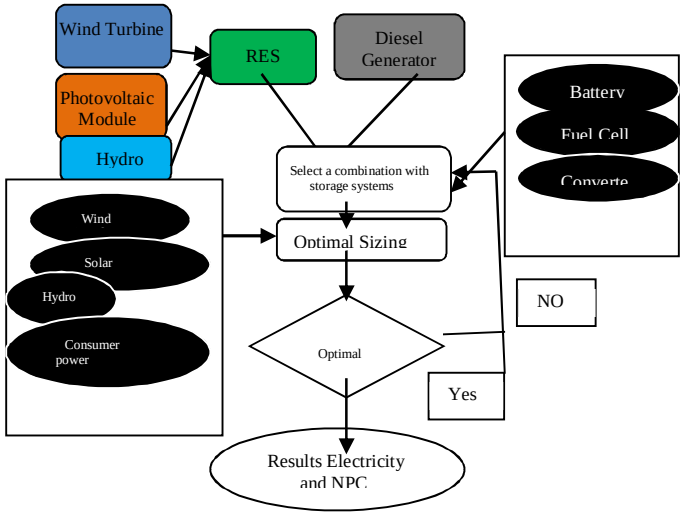



Fig.1. Flowchart for Optimal combination

## IV. MODELING OF COMPONENTS

Modeling of components in hybrid energy system

### *A. Wind System*

The wind system power output ($P_{WT}$) expression given by the following equation[17,18].

$$P_{WT}=\begin{cases} 0, & V_{(t)} \le V_{(cut\ in)} or\ V_{(t)} \ge V_{(cut\ out)} \\ Pr\dfrac{V^k-V^k_{(cut\ out)}}{V^k_{(cut\ out)}-V^k_r}, & V_{(Cut\ in)} < V_{(t)} < V_r \\ Pr, & V_r < V_t < V_{(cut\ out)} \end{cases} \quad (13)$$

Where v is wind speed, rated power is Pr (wind turbine), a Wind speed, cut_ in, cut_ out, rated speed of wind turbine and the number of a wind turbine are denoted by $V_{_cut\ in}$, V_cut-out, Vr, $N_{wind}$ respectively.

The overall power is given by

$$P_{wt}(t) = N_{wind} * P_{wt}(t) \quad (14)$$

### *B. Photovoltaic System*

PV system power output is given by

$$P_{PV}(t) = I(t) * A * \dot{\eta}_{PV} \quad (15)$$

Where I, A, and $\dot{\eta}_{pv}$ represents radiation of solar, PV area, PV panels and DC to DC converter overall efficiency. It is supposed that PV panels are having MPPT system. Npv is number of PV systems[24].

The overall output power of PV is

$$P_{PV}(t) = N_{PV} * P_{PV}(t) \quad (16)$$

The consumption of fuel in diesel generator set (ConsD (L/h) ) is given by,

$$ConsD = BD * PDN + AD * PD \quad (17)$$

Hourly diesel fuel cost is given by

$$C_f = P_{fuel} * ConsD \quad (18)$$

where the rated power PDN , power output of diesel generator PD, BD =0.0845 (litter/Kwh)and AD =0.246(litter/kWh) are consumption coefficients.Fuel Price is denoted as Pfuel.

### *C. Battery Model*

The battery bank charging capacity at time t can be expressed as:

$E_{Battery(t)}=E_{Battery(t_1)}*(1_\acute{\alpha})+[(E_{PV(t)}+E_{wt(t)}_E_{Load(t)}/\dot{\eta}_{inv}]*$

$\dot{\eta}_{Battery}$ (19) where

symbol $E_{Battery(t)}$ and $E_{Battery(t_1)}$, $\acute{\alpha}$, $\dot{\eta}$ inv, $E_{Load}$, $\dot{\eta}_{Batt}$ are battery bank charge capacities at time t and t_1, discharge rate hourly, inverter efficiency, demand, charge efficiency respectively [13].

$$E_{Battery(t)} = E_{Battery(t_1)} * (1_{\acute{\alpha}})[\frac{E_{Load(t)}}{\eta_{inv}.\eta_{PV}} + E_{wt(t)}] \quad (20)$$

$$CB = \frac{EL.AD}{DOD.\eta_{inv}.\eta_{b}.} \quad (21)$$

Where EL,AD,DOD, $\eta_{inv}$ and $\eta_b$ are load ,autonomy days (3-5 days), depth of discharge 80%, Inverter efficiency 95% and battery efficiency 85% respectively.

### *D. Hydro Power Output*

$$P_{hydro}=\frac{\eta hdro.\rho water.g.hnet.Qturbine}{1000} \quad (22)$$

$P_{hydro}$, $\dot{\eta}_{hydro}$,$\rho_{water}$,g ,$h_{net}$ and $Q_{turbin}$ denote power output of hydro (kW), Power turbine efficiency (85%),density of water ($Kg/m^3$),acceleration due to gravity ($9.8m/s^2$),effective head(meter) and hydro turbine flow rate ($m^3/s$) respectively.

f*) Analysis of cost:* COE is the total electricity price per unit of energy and calculated by the following equation.

$$COE\left(\frac{\$}{KWh}\right) = \frac{\text{Total Net Present Cost(\$)}}{\sum_{h=1}^{h=8760} Pload(h)(Kwh)} \quad (23)$$

CRF is the ratio of the present value system component in a system for a provided time period taking its interest rate into an account called as CRF.

It is given by the following expression :

$$CRF = \frac{(1+i)^n}{(1+i)^n-1} \quad (24)$$

Where i and n denote real interest rate and life period of the system.

### *E. Analysis of system reliability*

The power supply, loss of probability (LPSP) is a static parameter, which indicates the failure of probability either due to less renewable output or unable to fulfill the load demand by a technical failure[11].

$$LPSP = \frac{\sum P_{Load}-P_{PV}-P_{wind}+P_{BCS}+P_{Diesel}}{\sum P_{Load}} \quad (25)$$

### *F. Factor of Renewable*

Factor of Renewable

The renewable factor is diesel generated produced energy as compared to renewable energy. The 100% renewable factor means the ideal system which uses renewable energy sources only. However 0% renewable factor refers that diesel generator power supplied is equal to power from renewable energy resources.

$$\text{Renewable Factor (\%)} = (1-\frac{\sum P_{Diesel}}{\sum P_{PV}+\sum P_{Wind}}) \times 100 \quad (26)$$

## V. THE PROPOSED HYBRID OPTIMISATION ALGORITHM

### *A. Analysis of criteria and objective function*

Based on a broad discussion, a total of 15 numbers of different criteria are determined for the system to be taken into account. For different technologies, different values of each criterion can be set (example in Table 1).

Method of global criterion has been chosen for the most suitable structure for the given task [19]. Maximum and minimum values for each criterion have been calculated and used for converting the absolute values to the relative ones. Minimization criteria are obtained by dividing the value of criterion with optimal value (in most cases it is the minimum possible value of this criterion among all other alternatives) and maximization criteria obtained by dividing the optimal value (maximum) by value of considered criterion. The weights assigned to each criterion (from 0 to 100%) are set depending on the importance of the criterion.

The optimization process is finding minimum, maximum or optimum value of each decision variable criteria of TET criteria as per optimization function. A higher percentage of possible decision variable decides the size of Engineering, size of the wind turbine, hydro generation, size of generator and number of batteries. Strategy related to set of rules govern system operation and optimization process. It is a very useful tool to find a system with configuration out of various option and useful in the hybrid renewable power generation. Power management strategy along with energy storage devices, state of battery charging will depend upon total load demand and power output of wind and hydroelectric hybrid combination.

The objective function in the method of global criterion is

$$F = \sum_{N=1}^{15} \frac{C_N}{C_{N\max}} . W_n + \frac{C_{N\,min}}{C_N} . W_N \rightarrow \text{Min} \qquad (27)$$

$C_{N}$- The value of criterion $C_N$
$W_N$ %- the weight for the criterion $C_N$
$C_{N\,MAX}$- Maximum value for the criterion $C_N$ (for minimizing criteria)
$C_{N\,MIN}$- minimum value for the criterion $C_N$ (for maximizing criteria)

## VI. CASE STUDY OF SELECTED SITE

A remote village of Himachal Pradesh with population approx 4600 data taken in the designing of the proposed model of the different combination of hybrid generation. A hybrid renewable optimization model considering input data daily, hourly, monthly and yearly of load profile. It also takes solar radiation per months per watt per meter square, a variation of wind speed meter per second and water flow meter per second for the PV system, wind turbine, and hydroelectric system. The first state of the problem of taking the load profile consisting of the load for Residential, Public Administration Building, agriculture, transportation conventional, industrial and others. The pool of the hybrid renewable energy sources including solar wind hydropower and diesel as a backup is used to minimize fuel consumption and a battery energy storage device is used to store surplus energy.

Table 2. SOLAR RADIATION

| Month | Jan | Feb | Mar | April |
|---|---|---|---|---|
| Kwh/$m^2$/day | 5.33 | 5.56 | 6.61 | 6.40 |
| Month | May | June | July | Aug |
| Kwh/$m^2$/day | 6.53 | 4.66 | 3.17 | 2.97 |
| Month | Sept | Oct | Nov | Dec |
| Kwh/$m^2$/day | 5.09 | 7.86 | 7.16 | 6.32 |

The data of monthly average wind speed data at a 10m anemometer height of 50m above the surface of the earth is measured with average wind speed data of 10 years based on metrological and solar energy database and according to the data, annual average wind speed is 6.15 meter per second.

Table 3. WIND SPEED DATA

| Month | Jan | Feb | Mar | April |
|---|---|---|---|---|
| Wind speed m/s | 6.8 | 6.7 | 6.9 | 6.4 |
| Month | May | June | July | Aug |
| wind speed m/s | 5.9 | 5.57 | 5.00 | 5.05 |
| Month | Sept | Oct | Nov | Dec |
| wind speed m/s | 5.6 | 6.10 | 6.7 | 7.22 |

The proposed system hydropower is runoff river type which requires the determination of available head and flow rate of water with an annual average of 6.258 liters per second the data of hydro from Institute of water resources.

Table 4. DATA OF HYDRO RESOURCES

| Month | Jan | Feb | Mar | April |
|---|---|---|---|---|
| water stream flow (l/s) | 250 | 160 | 285 | 6.4 |
| Month | May | June | July | Aug |
| water stream flow (l/s) | 458 | 1698 | 24,300 | 30,500 |
| Month | Sept | Oct | Nov | Dec |
| water stream flow (l/s) | 6505 | 5800 | 950 | 740 |

Table 5. LOAD ESTIMATION OF SELECTED SITE

| Type | Electricity total demand in kWh | | |
|---|---|---|---|
| | *category* | *Energy consumption %* | *Electricity consumption, kWh* |
| Community & Residential Load Demand | Residential | 40% | 3000 kwh |
| | Public Buildings | 5% | 295.3 kWh |
| | Transport | 2.5% | 25 kwh |
| | Agricultural | 2.0% | 200.9 kwh |
| Industrial & commercial Load | Commercial | 25% | 2500 kwh |
| | Industrial | 10% | 2000 kWh |
| | Tourists | 15% | 1500 kwh |
| | others | 1.5% | 80.5 kwh |
| | | | 10000.8 Kwh |

Table.5 shows community load, which includes residential industrial and a commercial load of Himachal Pradesh. A capacity of 25 MW peak load is required to support and expand fully access of power consumption to the community.

## VII. RESULTS

Hybrid renewable system configuration for a community of 4600 population of Himachal Pradesh is analyzed and demonstrated with the use of multi-decision optimization evaluation methodology. This decision variable includes criteria of technical, environmental, economic and social (TEES) impact on the system . Presented case study shows the impact of diesel generation is minimized by use of energy storage devices. The result provides the most optimal configuration with a comparison on basis of total net present cost, operating cost of the system, cost of energy and a renewable factor of the system.

### *A. Optimized Result*

Table 5. OPTIMIZED RESULT

| System configuration | Total NPC | Operating cost | COE (Rs/Kwh) | Renewable fraction |
|---|---|---|---|---|
| PV, wind,hydo, battery | 670 M | 7250.750 | 4.425 | 91% |
| PV, hydro,battery | 715 M | 8505.420 | 4.875 | 90% |

### *B. Conclusion*


The proposed method provides the solution with a comparison of different configuration and gives the most optimized configuration with PV, wind, hydro and batteries. This project configuration simulated for the site of Himachal Pradesh for increasing its qualitative value of Environment and tourism and impress more positive impact on reduction in $CO_2$ and GHS gases emission which helps to reduce global warming effect. This optimized configuration is very much useful for the industrial development of the woolen market and improves culture and heritage to increase revenue to add economic benefits. This multi-decision Optimization is helpful to take decision for environmental, technical and economic benefits with improved structure of government policies and awareness to the community. This system configuration making the availability of electricity helps to improve living standard by providing education economics help and job opportunities. Therefore proposed hybrid system minimizes COE and improve renewable factor further reduces operating cost by minimizing fuel consumption.

## REFERENCES

[1] Canada Mortgage and Housing Corporation (2010). Photovoltaic (PV) Systems. Available to: http://www.cmhcschl.gc.ca/en/co/maho/enefcosa/enefcosa_003.cfm/.
[2] Canadian Solar Industries Association (2010). Solar Vision 2025: Beyond Mar-ket Competitiveness. Tech. rep.
[3] M. Delucchi, M. Mark Jacobson (2011). Providing all global energy with the wind, water, and solar power: Part II". energy policy 39.3, pp. 1170{1190. DOI: 10.1016/j.enpol.2010.11.045.
[4] Ontario Power Authority, "Technical Report for the connection of Remote First Nation Communities in NorthwestOntario For Northwest Ontario First Nation Transmission Planning Committee", 2012.
[5] Energy Information Administration (US): 'International energy outlook 2013 with projections to 2040' (Department of Energy, Washington DC, 2013).
[6] The Paris Agreement'. Available at http://unfccc.int/paris_agreement/items/9485.php, accessed 02 March 2017
[7] Inglesi-Lotz, R: The impact of renewable energy consumption to economic growth: a panel data application', Energy Econ., 2016, 53, pp. 58–63.
[8] Adefarati, T, Bansal, R.C: 'Integration of renewable distributed generators into the distribution system: a review', IET Renew. Power Generation, 2016, 10,(7), pp. 873–884
[9] Fu, Q,Nasiri,A,Solanki,A,et al.:'Microgrids: architectures, controls, protection, and demonstration', Electr. Power Compton. Syst., 2015, 43, (12), pp. 1453–1465
[10] Arseniev, D.G, Shkodyrev, V.P., Yarotsky, V.A., et al.: 'The model of an intelligent autonomous hybrid renewable energy system based on Bayesian network'. IEEE Eighth Int. Conf. Intelligent Systems (IS), Sofia, Bulgaria, 2016, pp. 758–763
[11] Zobaa, A.F., Bansal, R.C.: 'Handbook of renewable energy technology'(World Scientific, Singapore, 2011)
[12] Yap, W.K., Karri, V.: 'An off-grid hybrid PV/diesel model as a planning and design tool, incorporating dynamic and ANN modeling techniques', Renewable Energy, 2015, 78, pp. 42–50
[13] Chauhan, A., Saini, R.P.: 'Renewable energy based off-grid rural electrification in the Uttarakhand state of India: technology options, modeling method barriers, and recommendations, Renew. Sustain. Energy Rev., 2015, 51, pp. 662–681.
[14] Zhao, B., Zhang, X., Chen, J., et al.: 'Operation optimization of standalone microgrids considering lifetime characteristics of battery energy storage system', IEEE Trans. Sustain. Energy, 2013, 4, (4), pp. 934–943.
[15] Deshmukh, M.K., Deshmukh, S.S.: 'Modeling of hybrid renewable energy systems', Renew. Sustain. Energy Rev., 2008, 12, (1), pp. 235–249
[16] Twidell, J., Weir, T.: 'Renewable energy resources' (Routledge, New York, USA, 2015)
[17] Serrano, E., Rus, G., García-Martínez, J.: 'Nanotechnology for sustainable energy', Renew. Sustain. Energy Rev., 2009, 13, (9), pp. 2373–2384
[18] Zäch, M, Hägglund, C., Chakarov, D., et al.: 'Nanoscience and nanotechnology for advanced energy systems', Curr. Opin. Solid State Mater.Sci., 2006, 10, (3–4), pp. 132–143.
[19] Guo, K.W: 'Green nanotechnology of trends in future energy: a review', Int. J. Energy Res., 2012, 36, (1), pp. 1–17.
[20] REN21, 'Renewable 2017 Global Status Report'. (UN Environment, Paris, 2013), pp. 44–95
[21] Yang, H, Lu, L, Zhou, W: 'A novel optimization sizing model for hybrid solar–wind power generation system', Sol. Energy, 2007, 81, (1), pp. 76–84
[22] Zhou, W., Lou, C, Li, Z, et al.: 'Current status of research on the optimum sizing of stand-alone hybrid solar–wind power generation systems', Appl. Energy, 2010, 87, (2), pp. 380–389
[23] Bajpai, P., Dash, V.: 'Hybrid renewable energy systems for power generation in stand-alone applications: a review', Renew. Sustain. Energy Rev., 2012, 16, (5), pp. 2926–2939
[24] Luna-Rubio, R., Trejo-Perea, M., Vargas-Vázquez, D., et al.: 'Optimal sizing of renewable hybrids energy systems: a review of methodologies', Sol. Energy, 2012, 86, (4), pp. 1077–1088
[25] Yang, H., Wei, Z., Chengzhi, L.: 'Optimal design and techno-economic analysis of a hybrid solar–wind power generation system', Appl. Energy, 2009, 86, (2), pp. 163–169
[26] Qi, Z., Lin, E.: 'Integrated power control for small wind power system', J. Power Sources, 2012, 217, pp. 322–328
[27] Díaz-González, F., Sumper, A., Gomis-Bellmunt, O., et al.: 'Energy smoothing', Appl. Energy, 2013, 110, pp. 207–219
[28] Elma, O., Selamogullari, U.S.: 'A comparative sizing analysis of a renewable energy supplied stand-alone house considering both demand side and source side dynamics', Appl. Energy, 2012, 96, pp. 400–408
[29] Lupangu, C., Bansal, R.C.: 'A review of technical issues on the development of solar photovoltaic systems', Renew. Sustain. Energy Rev., 2017, 73, pp. 950–965
[30] Maleki, A.; Askarzadeh, A. Comparative study of artificial intelligence techniques for sizing of hydrogen-based stand-alone photovoltaic/wind hybrid system. Int. J. Hydrog. Energy 2014, 39, 9973–9984

[31] Yang, H.; Wei, Z.; Lou, C. Optimal design and techno-economic analysis of a hybrid solar-wind power generation system. Appl. Energy 2009, 86, 163–169.
[32] Diaf, S.; Diaf, D.; Belhamel, M.; Haddadi, M.; Louche, A. A methodology for optimal sizing of autonomous hybrid PV/wind system. Energy Policy 2007, 35, 5708–5718.
[33] Borowy, B.S.; Salameh, Z.M. Methodology for optimally sizing the combination of a battery bank and PV array in a wind/PV hybrid system. IEEE Trans. Energy Conversion. 1996, 11, 367–375.
[34] Abhishekh ku,R.C.Bansal,"A noval methodological framework for the design of sustainable rural microgrid for developing nations ,IEEE ,Transcations,2018

©IJRASET: All Rights are Reserved | SJ Impact Factor 7.538 | ISRA Journal Impact Factor 7.894 |

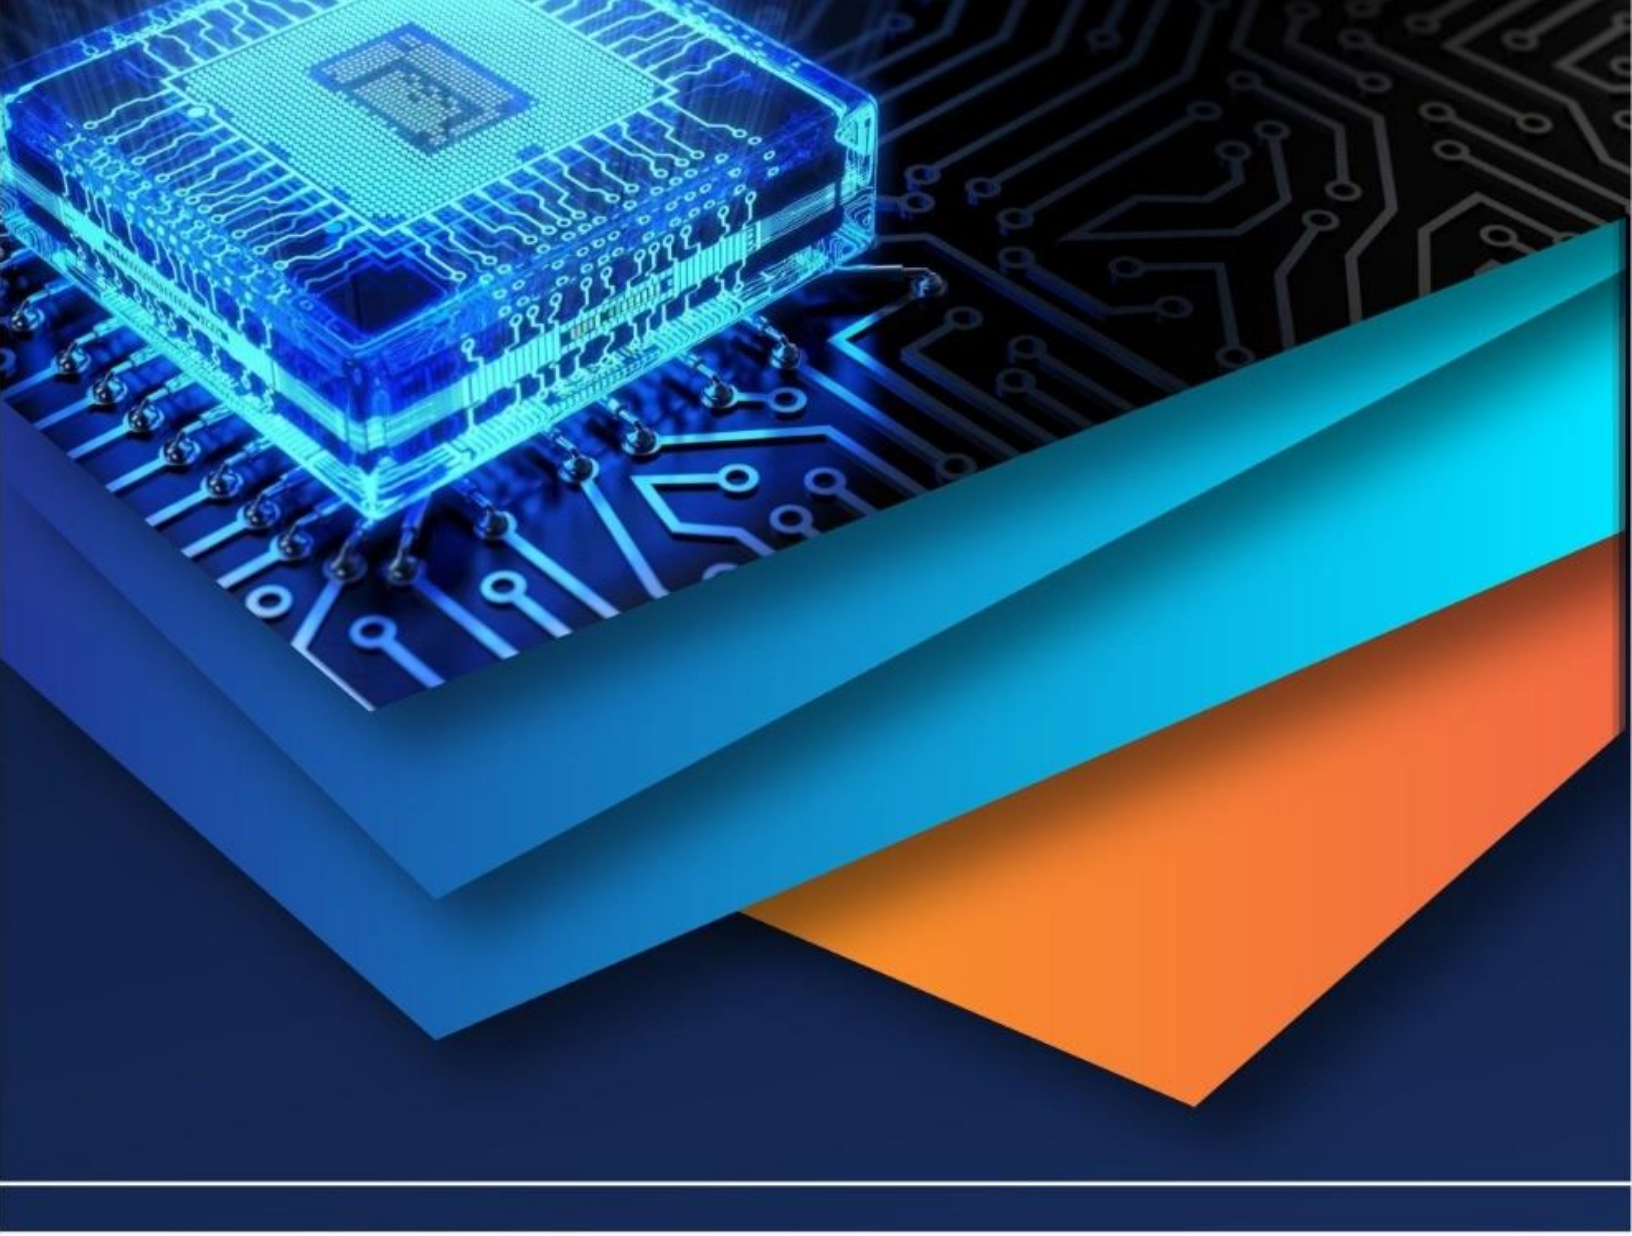

10.22214/IJRASET

45.98

IMPACT FACTOR: 7.129

IMPACT FACTOR: 7.429

# INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

Call : 08813907089 (24*7 Support on Whatsapp)