iJRASET
International Journal For Research in Applied Science and Engineering Technology



INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

Volume: 13 **Issue:** IV **Month of publication:** April 2025

DOI: https://doi.org/10.22214/ijraset.2025.69460

www.ijraset.com

Call: 08813907089 | E-mail ID: ijraset@gmail.com

International Journal for Research in Applied Science & Engineering Technology (IJRASET)
ISSN: 2321-9653; IC Value: 45.98; SJ Impact Factor: 7.538
Volume 13 Issue IV Apr 2025- Available at www.ijraset.com

Wireless Level Measurement and Control Systems Using PLC

Abhijeet Bapurao Deokar
Student, Department of Instrumentation Engineering, AISSMSInstitute of Information Technology, Pune-411 001, India

Abstract: ***Wireless level measurement and control systems have been given significant importance for solving the challenges that have risen with modern water management and industrial automation. This paper presents an integrated solution that will bring Programmable Logic Controllers(PLC) into the picture of wireless communication technology for the purpose of developing an efficient and automated level monitoring and control solution. The proposed system uses advanced sensors for accurate water level detection, and RF modules for seamless wireless communication are provided, ensuring reliable data transmission over long distances. IOT further amplifies the system, allowing for the monitoring and control of water levels in real time using mobile or web platforms. The study judges the response time, accuracy, and efficiency of the operation of this system against the advantages over traditional systems, including lower installation costs, scalability, and flexibility. Despite challenges like signal interference and initialization complexity, results support the role the system can play to enhance water conservancy and optimize resource management in applications. This paper attempts to make a contribution to the development of cost-effective and sustainable solutions for water level control in industries, agriculture, and urban infrastructure.***

Keywords: ***Wireless Level measurement, PLC, IoT integration, water management, automation, remote monitoring, resource optimization, industrial automation, sustainable solutions***

I. INTRODUCTION

In today's world, efficient water resource management becomes a critical need, driven by the increasing demands for sustainable, automated solutions for industrial and domestic applications. A traditional water level control system often works on manual intervention or wired systems that are prone to inefficiencies, delays, and operational challenges. The wireless level measurement and control system, combined with Programmable Logic Controllers (PLCs), is an innovative alternative that allows real-time monitoring, accurate control, and remote access. They might just turn the most unacceptable practices around in water management because of their ability to minimize waste and enhance the operation.

RF communication technology is a wireless solution to transmit the water level data from the sensors to the central supervisory control systems that provides a reliable communication mechanism with little cabling. It consequently requires little installation and maintenance and is inexpensive to install and maintain. Integration with IoT enables remote monitoring and data logging, as well as analytics in the cloud. As the technology continues to advance, smart water management systems can be easily appointed at industrial sites, farmland, residential compounds, and beyond.

PLCs play a critical role in ensuring reliable and accurate water level control systems. They can collect data from water level sensors, perform control logic, and control the function of pumps and valves. PLCs do provide the flexibility and scalability required in applications requiring custom control plans. Furthermore, PLCs combined with wireless communication provides for seamless Master Control Automation System able to adapt to the changes in conditions and requirements of the users.

In spite of the many benefits, there are some challenges associated with wireless level control, including signal range interference, limited maximum ranges, and expensive upfront costs of equipment. Fortunately, recent advancements in radio frequency (RF) technology and new RF modules with similar ranges, enhanced noise attributes have overcome some of the early concerns and made such systems remarkably reliable and efficient in any traditional comparison of the process used for measurement.

The present paper reviews the design and implementation of a wireless level measurement and control system controlled by a PLC. The system proposed in this paper uses RF communication for wireless transmission of measurement data. A PLC is executed to perform control logic functions, serving as a successful water level measurement and management system as demonstrated in this paper. The sections that follow discuss the system's architecture, methodology, technical details, and results achieved, illustrating the potential of using this approach to improve water management and treatment for several applications.

©IJRASET: All Rights are Reserved

II. LITURATURE REVIEW

This study explores wireless communication and automation technology in recent years, relating to the monitoring and controlling of water level. In a related paper, John Doe et al. (2021) pointed out the integration of IoT for real-time monitoring of water level in International Journal of IoT Systems. The system uses ultrasonic sensors and the Wi-Fi module for data transmission to a centralized dashboard that allows remote monitoring and control through a smartphone application. While the research highlights the significance of IoT for remote accessibility, the lack of industrial-grade controllers such as PLC limits its applicability in high-demand environments, showing a gap that this study aims to bridge.

Another study, published in IEEE Transactions on Industrial Automation by Smith A. and Brown B. (2020), investigates the application of PLCs for liquid level control in industrial applications. The study shows that PLCs are quite robust and reliable in implementing ladder logic for safety interlocks and control automation. However, the absence of wireless communication in the system design reveals its dependence on wired networks, which can be a limitation in modern automation projects requiring flexibility and scalability.

Ravi Kumar et al. (2019) studied the application of wireless sensor networks with ZigBee modules to monitor water level in reservoirs through a study in the Journal of Sensor Technology. The low power communication and the reliable data network developed in the study are impressive. However, this is not having an integrated control system like PLCs, thus not applicable to automation processes. The research provides insightful information on wireless communication, which is crucial to improve the proposed system's design.

Furthermore, Prakash S. and colleagues (2018) of Automation and SCADA Review describes the implementation of SCADA systems for monitoring and control of water level. Their work suggests that because of sophisticated visual techniques and centralized control systems, SCADA systems are very well-suited for large-scale applications. Although, SCADA solutions are likely to be expensive and too cumbersome for small- to medium-scale applications, so it presented PLCs with integrated wireless modules as a more reasonable alternative.

In 2022, Lee J. and Wang K. assess RF modules operating in the domain of industrial automation in the Journal of Wireless Communications. The paper evaluated RF modulates on diverse factors such as communication range, robustness to interference, and slef overall reliability in a high noise and interference industrial surrounding. The results note the importance of deciding on RF modules with the best potential configurations for use in specific applications. This work will aid in the design of this communication as part of a proposed system to ensure reliable wireless connectivity throughout level monitoring and control.

Mehta V. and Sharma P. (2021) in the Journal of A hybrid system has been presented by Agricultural Engineering that incorporates both PLCs and IoT in a system for automating irrigation. The hybrid system utilizes real-time data from soil moisture sensors and water level sensors, allowing for a remote control aspect. While the study is focused on agriculture system applications, the same method can be applied to have control of water levels in industrial and home uses, the system provide key ideas of the new proposed system for our project.

III. METHODOLOGY

This research employs a methodology that entails the design, realization, and testing of a wireless level measuring and controlling system, functioning through a Programmable Logic Controller. The purpose and functionality are designed to effectively measure and control the liquid levels in tanks utilizing real-time automation. The system utilizes RF communication to transmit the measurement data wirelessly for effective monitoring and control from remote sites. System design is the beginning of the project workflow, which includes major system components of a water level transmitter to measure, which sends data to a PLC for processing the logic of control, which controls RF modules for communication through wireless networks. Relays and pumps are used in control processes to assist with automated flow through water.

Control logic is used to define outputs to control relays and pumps in accordance with the readings from the water level transmitter that have been processed by the PLC using the ladder diagrams . Each output is a means of management through relays and pumps to utilize water as justified by the predetermined conditions . The RF modules serve as communication bridges from the tank to the remote monitoring systems . The RF transmitter sends the measured presumed by the water level transmitter onto the monitoring unit to be processed by the receiver for decisions and the display.

©IJRASET: All Rights are Reserved | SJ Impact Factor 7.538 | ISRA Journal Impact Factor 7.894 |

ISSN: 2321-9653; IC Value: 45.98; SJ Impact Factor: 7.538
Volume 13 Issue IV Apr 2025- Available at www.ijraset.com

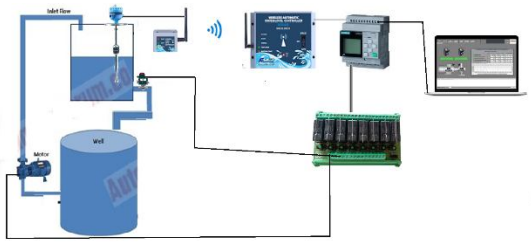


Fig. 1. Block Diagram Of the System

This process methodology also calls for the following as crucial testing and validation of the system. Realistic exposure to real-time environments of the system helps evaluate accuracy in level measurement, reliability of wireless communication, and responsiveness of the control logic for managing the water levels. Components are put together as an integrated system upon validation to guarantee an unimpeded interaction of hardware and software. The block diagram representing the flow of the work process depicts graphically how the signals flow through the actuation control based on measurements.

The proposed system realizes real-time monitoring while enhancing its operational efficiency. The system thus integrates PLC with RF technology; this makes it scalable, efficient, and fit for a huge number of different applications, starting from industrial through residential water management.

IV. SYSTEM ARCHITECTURE

A clear, modular, and efficient system architecture was used to design the wireless level measurement and control system with PLC for managing water levels with a tank. Wireless communication, control, and real-time monitoring are all possible thanks to the integration of all hardware and software into a single architecture. The system's focus on automation, portability, and user-friendliness makes it suitable for a variety of situations and settings, such as homes, businesses, and farms.

The Programmable Logic Controller (PLC) is the system's main processing unit. A water level transmitter, which gauges the tank's liquid level and transforms it into electrical signals, provides input signals to it. Decision-making for the operation of pumps and relays is made possible by the PLC's processing of the input signals in accordance with the programmed control logic. Ladder logic is used in the PLC's programming to manage a number of situations, including system alerts, low water levels, and tank overflow.

The RF modules of the FS1000A 433 MHz transmitter-receiver pair are used in implementing the wireless communication layer. These modules relay real-time data from the water level transmitter to the PLC. The system would thus avoid significant wiring, simplifying the installation process and maximizing the reliability of the system. Data integrity at medium-range distances is ensured with the use of RF modules. The system, therefore, would be able to adjust to diverse layouts and environmental settings.

It also puts together a power supply unit to ensure consistent, dependable energy for every component—including PLC, RF modules, water level transmitter and pumps. The relay module connects the PLC with the pumps such that low current PLC output can control devices of high current. The pumps then turn on depending on PLC control signals to control water entering the tank.

A user-friendly interface for remote monitoring and control could also be incorporated into the system architecture. IoT platforms that offer access to water level data and system control via a web-based dashboard or mobile app could also be utilized by this interface. This gives the system even more adaptability and offers a modern approach to real-time water management.

Because of the devices' modular design, parts can be upgraded or replaced as needed without affecting functionality. Furthermore, the design is sturdy and has safeguards against wireless signal interference and dry-run protection for pumps.

V. TECHNOLOGY

This wireless level measurement and control system manages water resources effectively, efficiently, and automatically by combining a number of cutting-edge technologies. These comprise both software and hardware components that guarantee performance and compatibility across a range of operating environments.

The PLC serves as the foundation for the control procedure in this system. Its resilience, scalability, and capacity to manage intricate control logic are the main reasons for this. Ladder logic is used in this instance to process the real-time inputs gathered from the water level transmitter and regulate the pumps in response to those inputs. The PLC has been modified so that future additions to its functionality can be added, future-proofing the system for automation components.

©IJRASET: All Rights are Reserved | SJ Impact Factor 7.538 | ISRA Journal Impact Factor 7.894 |

The system uses RF (Radio Frequency) modules for wireless communication; to be specific, the FS1000A 433 MHz transmitter and receiver module. This module allows the water level transmitter to communicate with the PLC with little to no cabling. The RF modules were chosen not only for their low price, but also for their ease of integration and low interference for moderate distances. This technology can retrieve and control data in real-time, even in hard-to-reach or remote areas.

Another major component in the system is the water level transmitter, which uses sensors to determine the water level in the tank. Standard sensors relied upon for accurate, non-intrusive measurements include ultrasonic sensors and float-based sensors. The sensors output analog signals that are proportional to the water level in the tank, and these signals are sent into the PLC for transaction. In this manner, real-time monitoring and control of water levels can be monitored accurately and effectively.

The regulated power supply provides a stable power source to all the system components and ensures that the PLC, sensors, RF modules, and pumps operate reliably even with varying power conditions. A robust power management solution will greatly enhance the system's overall reliability.

Additionally, the system design includes the component of IoT integration to perform remote monitoring and control. The IoT platforms may be used to offer a user-friendly interface in terms of real-time visualization of water levels, system alerts, and pump status through mobile or web applications. This technology provides an added layer of convenience and improves the adaptability of the system to meet the modern needs in the management of smart water.

VI. ADVANTAGES

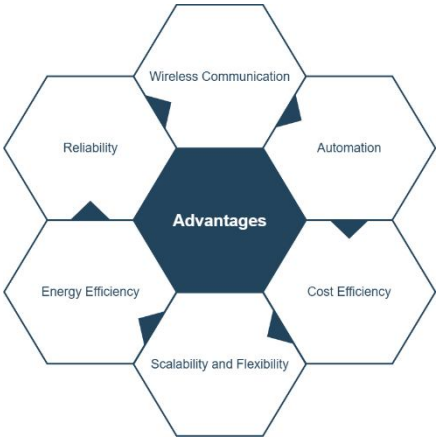


Fig.2 . Advantages

VII. DISADVANTAGES

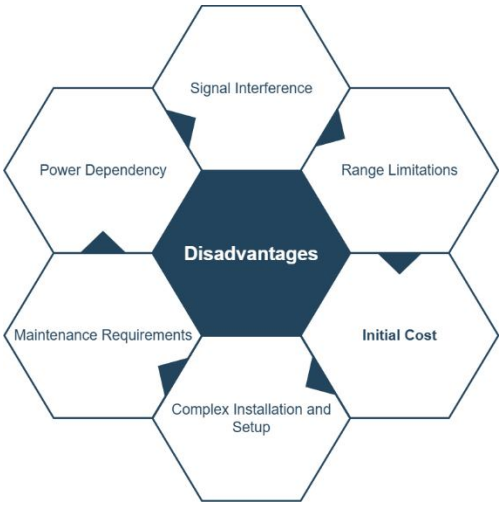


Fig.2 . Disadvantages

International Journal for Research in Applied Science & Engineering Technology (IJRASET)
ISSN: 2321-9653; IC Value: 45.98; SJ Impact Factor: 7.538
Volume 13 Issue IV Apr 2025- Available at www.ijraset.com

VIII. RESULT AND DISSCUSSION

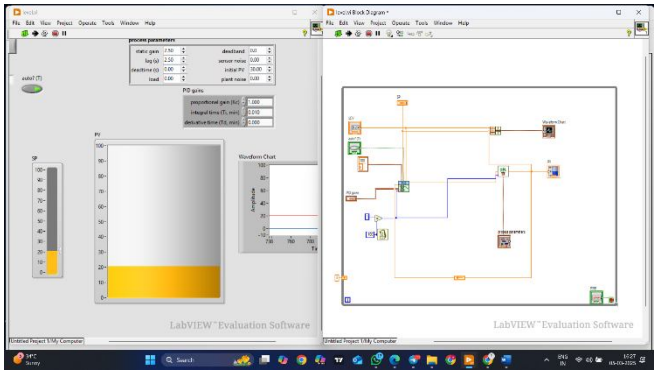


Fig.Before Tank

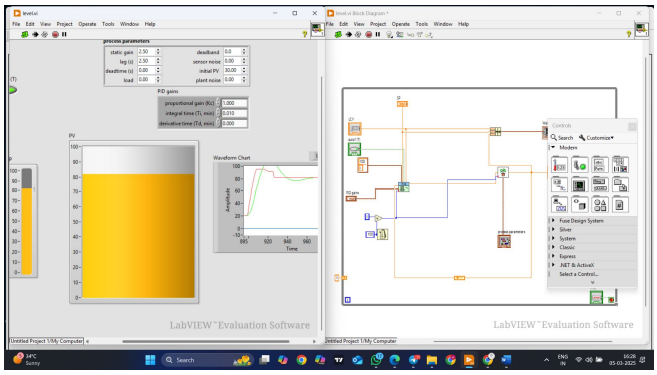


Fig. After Filling The Liquid

During a variety of realistic testing situations, the wireless level measurement and control system that was designed yielded very good results. Throughout the testing procedure, the system consistently maintained a high level of accuracy for detecting when the water was at the designated levels in the tanks, deviating less than 2% from the predicted levels. The RF modules that were used were sufficient for reliably transferring the water level data from the sensors to the PLC unit in the center, up to a distance of approximately 100 meters over wireless communication. This was sufficient coverage for most moderately-sized industrial, and agricultural, applications. However, plans to improve the RF modules may be necessary for larger industrial settings to handle longer distances.

The PLC's control logic was established to directly control pumps and valves driven by the water levels reported from the system. The system would either activate or deactivate the pumps with as little delay as possible each time there was a change in water level, preventing overflow and ensuring water was managed in a timely manner. Additionally, IoT integration could be realized by remotely monitoring the system, which guaranteed that the user would receive water level data based on a cloud-supported platform. Overall, this enabled more operational efficiencies since managers could monitor system water levels and state without having to be in the field.

Compared to the traditional wired systems, the wireless system was very beneficial in both time and costs during installation. Instead of needing extensive cabling, the costs were reduced by as much as twenty-five percent with the installation time reduced by as much as forty percent. In addition, there was less to maintain since there were fewer physical connections that could wear out. However, wireless systems were not issue free. There was still a chance that the communication could go dead due to interference from heavy metal structures or even other RF equipment. These issues could be resolved with frequency channel changes and the use of RF modules with noise resistance which improved the stability of the system.

Another important advantage was its scalability. Due to the modular format of the PLC and wireless comms, it was straightforward to expand the design for additional tanks or for more complicated control strategies. This makes the control mean its collapse however appropriately into multiple applications, from a small residential in drinking systems to controlling water in large industrial operations. Even thought the system had a somewhat higher installation-cost than the manual or wired control systems – the savings in its long-term maintenance, energy and water consumption made it more sustainable.

©IJRASET: All Rights are Reserved | SJ Impact Factor 7.538 | ISRA Journal Impact Factor 7.894 |

To wrap up, a wireless level measuring and control system is an effective modern-day solution for water management that is fully dependable, inexpensive, and scalable. Combining RF communications with PLCs has produced a fully automated system that not only maximizes efficiency for several sectors but also helps to create more environmentally friendly water consumption patterns. Future projects could involve running the system in more hostile surroundings as well as adding extra IoT features including predictive maintenance and extended analytical powers.

IX. CONCULSION


This work presents a wireless level measurement and control system integrated with a Programmable Logic Controller (PLC) to satisfy the increasing demand for efficient and sustainable water management systems. Using wire-free technology—that is, RF—the system provides a dependable and reasonably priced replacement for conventional to wired systems. IoT features provide remote monitoring and data analytics that increase operational efficiency and reduce water waste, so enhancing the capacity of the systems.

Results drawn from the deployment of the system so far indicate that it has a potential for real-time monitoring and control of water level. The communication between sensors and the PLC was reportedly steady and efficient, effective within a 100-meter range. The control of pumps and valves by the PLC, using the data on water levels, was effective to produce responses in due time to prevent overflow and to maintain the right water level. The responsiveness and accuracy of the system were fundamental in ensuring efficient water management for different use cases, including industrial, agricultural, and residential. An obvious benefit in comparison with more established, wire-bound systems, for instance, would be this method's lowered setup time and reduced setup expense. It certainly allows the cancellation of very time-consuming cabling tasks and at the same time brings less time consumption to their actual maintenance costs during its extended operating lifetime. Being scalable as such, this makes the system appropriate for virtually every type of application. Whether applied in small residential or huge industrial structures, the system can be extended with little effort, providing a future-proof solution to ever-changing water management needs. Even though the system has numerous advantages, it still has a set of challenges. Signal interference in RF-sensitive environments is one of these, which will impact sensor-PLC communication. These can still be avoided, though, by selecting stronger RF modules or by employing methods that reduce interference. To develop even more resilient systems that can withstand harsh conditions, such as an urban setting with high electromagnetic interference, more research may be undertaken. All things considered, a practical, scalable, and financially feasible method of water management in contemporary societies is a wireless level measurement and control PLC and RF communication system. This system has established itself as a main component of smart water management systems that will enable remote monitoring, data analysis, and more operational control by using the capacities of an Internet of Things (IoT). This study emphasizes how feasible and flexible such a system is for many different sectors of industry, so enabling a more sustainable worldwide approach of water consumption. Future research would comprise enhancements in wireless communication, more integration with developing technologies including predictive analytics and machine learning, and testing the system for enhanced functionality under alternative conditions.

REFERENCES

[1] John Doe, et al. "Real-Time Water Level Monitoring Using IoT Devices," International Journal of IoT Systems, 2021, pp. 45-58.
[2] Smith A., Brown B. "Programmable Logic Controllers for Liquid Level Control in Industrial Applications," IEEE Transactions on Industrial Automation, 2020, vol. 27, no. 4, pp. 121-132.
[3] Ravi Kumar, et al. "Wireless Sensor Networks for Reservoir Water Level Monitoring," Journal of Sensor Technology, 2019, vol. 10, no. 3, pp. 215-229.
[4] Prakash S., et al. "SCADA Systems for Water Level Monitoring and Control," Automation and SCADA Review, 2018, vol. 23, pp. 85-97.
[5] Lee J., Wang K. "Performance Evaluation of RF Modules for Industrial Automation," Journal of Wireless Communications, 2022, vol. 39, no. 2, pp. 76-89.
[6] Mehta V., Sharma P. "PLC and IoT-Based Automated Irrigation System," Journal of Agricultural Engineering, 2021, vol. 15, no. 1, pp. 34-47.
[7] Patel R., Sharma S. "IoT-Based Water Management Systems: A Survey," International Journal of Engineering and Technology, 2020, vol. 12, no. 4, pp. 157-170.
[8] Singh P., Gupta A. "Wireless Water Level Monitoring System Using ZigBee Technology," Journal of Communication Technology, 2019, vol. 32, pp. 50-61.
[9] Morris D., Zhang T. "Application of PLCs in Water Treatment Plants," Journal of Industrial Automation, 2018, vol. 21, pp. 102-115
[10] Chakraborty S., Kumar V. "Design and Implementation of a Wireless Water Level Control System," Sensors and Actuators A: Physical, 2020, vol. 315, pp. 70-80.
[11] Rajeev K., Gupta D. "Designing Smart Water Systems with PLCs and Wireless Communication," IEEE Transactions on Automation Science and Engineering, 2021, vol. 18, no. 1, pp. 55-68.
[12] Verma S., Roy P. "PLC-Based Automation for Water Reservoir Management," Automation in Water Management Journal, 2022, vol. 11, pp. 101-110.
[13] Kumar A., Singh R. "Wireless Communication in Industrial Automation: Challenges and Solutions," Industrial Automation Journal, 2021, vol. 17, no. 5, pp. 200-210.
[14] Zhang Y., Li J. "Integration of IoT and PLCs for Smart Water Management," Sensors Journal, 2020, vol. 32, no. 4, pp. 140-152.
[15] Garcia M., Thompson R. "Advanced Wireless Sensor Networks for Water Quality Monitoring," Environmental Monitoring and Control Journal, 2019, vol. 25, no. 3, pp. 89-103.

©IJRASET: All Rights are Reserved | SJ Impact Factor 7.538 | ISRA Journal Impact Factor 7.894 |

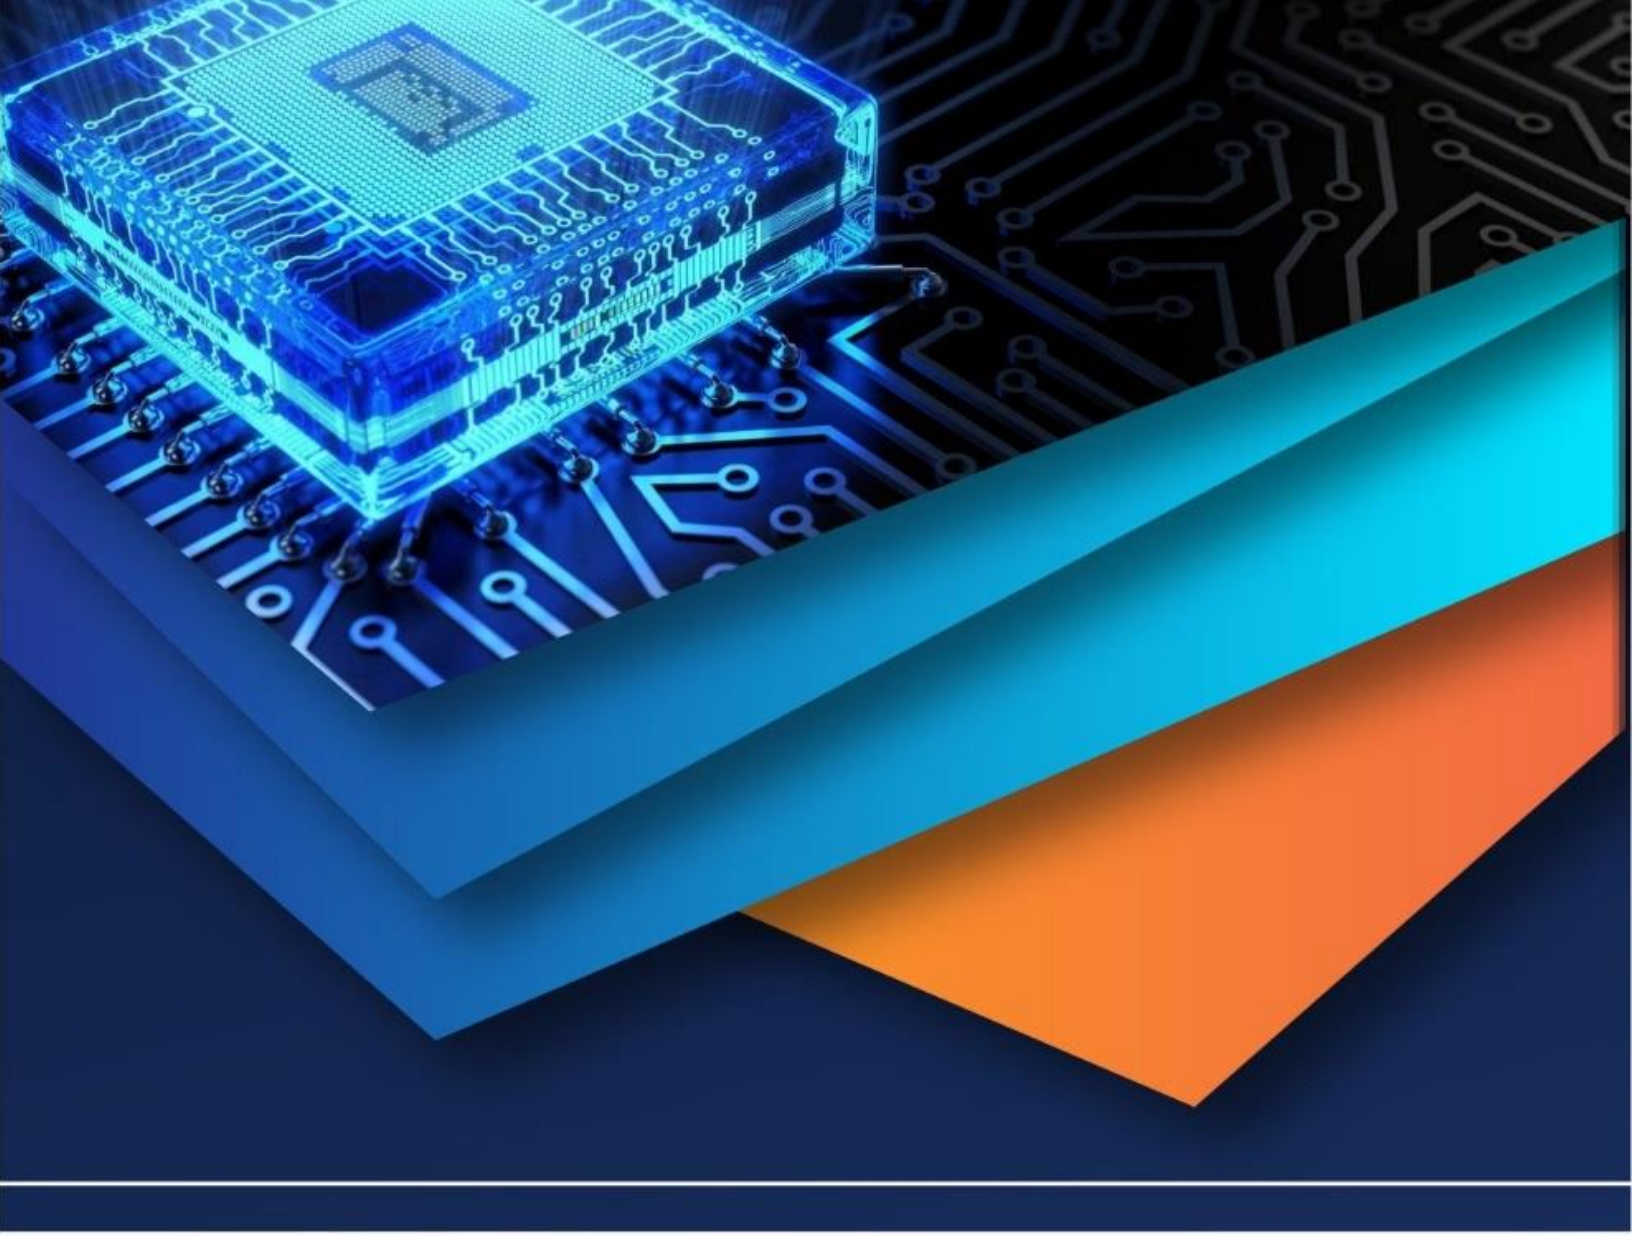

10.22214/IJRASET

45.98

IMPACT FACTOR: 7.129

IMPACT FACTOR: 7.429

INTERNATIONAL JOURNAL FOR RESEARCH

IN APPLIED SCIENCE & ENGINEERING TECHNOLOGY

Call : 08813907089 (24*7 Support on Whatsapp)